

Date: **January 20, 2026**
Project: **Shageluk Bulk Fuel Upgrades**
Solicitation No.: **ITB 26030**
Addendum No.: **01**

TO ALL PLAN HOLDERS:

The following changes, additions, clarifications, and/or deletions are hereby made a part of the ITB Documents for the above noted project, fully and completely as if the same were fully contained therein. All other terms, conditions, and specifications of the original Invitation to Bid remain unchanged.

This addendum must be acknowledged by email.

The modifications directed by this Addendum One are described on this page.

CHANGES TO DOCUMENTS:

The ITB Package is hereby clarified, changed or modified by the following:

1. **Question:** Can you extend the bid opening one week?
Answer: Yes. Extend the solicitation by one week, February 3rd, 2026. All questions due January 27th, 2:00 PM.
2. **Question:** Can you extend bid opening for two weeks?
Answer: Bid opening extended for one week.
3. **Question:** Will there be a live bid opening to attend?
Answer: Bid opening link: Yes, telephonically.
Dial in by phone
[+1 469-810-0642](tel:+14698100642), [876920109#](tel:+1876920109) United States, Ennis
Phone conference ID: 876 920 109#
4. **Question:** Who manufactured the owner furnished tanks?
Answer: Regal Tanks LTD / Tidy Steel-Fab LTD
5. **Question:** Are these tanks still in production or are they complete?
Answer: The tanks are in fabrication. The contract includes delivery FOB Seattle Docks by April 15th, 2026.
6. **Question:** If complete, where are they currently being stored?
Answer: See response above.
7. **Question:** I see that shop drawings for those tanks are referenced throughout the drawings, but I didn't see them as part of the RFP. Can we get a copy of those drawings?
Answer: Owner Provided 30,000-gallon tank shop drawings are attached.

8. **Question:** Is there housing available for rent through any of the local village authorities?
Answer: Yes, housing is available as well as a lot for temporary contract camp. Lot is privately owned. Price for access will have to be negotiated by contractor.
9. **Question:** Is there an AC Store or other grocery store in the village?
Answer: Yes, ANICA store and one evening convenient store.
10. **Question:** How much fuel in the existing 25,000 tank.
Answer: This 25,000-gallon tank is the primary diesel storage tank for the community. Assume it to be full and bring enough temporary storage to accommodate volume.
11. **Question:** Burn rate of power plant?
Answer: Approximately 3,000 gallons per month in the summer.
12. **Question:** Who is responsible for fueling the fuel tanks after installation?
Answer: The contractor is responsible for transferring and filtering any existing fuel in owner tanks to new facility. The new tanks must be available to receive by the arrival time of the fall fuel barge, the owner/operator will be responsible for purchasing the additional fuel, the contractor will coordinate with the owner/operator on schedule and volume of delivery.
13. **Question:** Is there power available to hook up a man camp? If so, what are the kilowatt hour charges?
Answer: Property formerly used by Cruz construction owned privately and has electric utility access. Local utility is owned by AVEC and subject to their commercial rates.
14. **Question:** Can you provide shop drawings?
Answer: Included in this addendum.
15. **Question:** What equipment is available in Shageluk?
Answer: Used D5 Dozer high track open cap
120 Hitachi Excavator
a. Hitachi 85 Excavator
b. 120 Volvo Loader
c. ASV Tracked Skid Steer 2500 lb. lift
d. Bobcat t190 wide track skid steer
e. Dump truck
f. Water truck
i. Pick up and side by side available to rent as well
16. **Question:** What is the contact information for Big Wheel Transport owner?
Answer: Chevie Roach -bigwheelhauling@gmail.com -(907)-590-1817
17. **Question:** What is the price for the onsite gravel?
Answer: The material is available to the contractors at a previously negotiated rate of \$30,000.00. This item is not eligible for contractor material item markup.
18. **Question:** Email the sray@aidea.org, that was referenced in the questions section, and it came back as undeliverable.
Answer: The referenced email address is no longer active. Please use the updated email address scray@akenergyauthority.org for all communications.

The following links are provided as additional reference material related to the original document.
Links to Matterport 3D explorable photogrammetry spaces of Shageluk City Tank Farm and AVEC tank farm site.

[Space - Shageluk City Tank Farm](#)

Tanks on City site are to be decommissioned not location of new construction for the collocated tank farm. City tanks are empty of fuel or sludge.

[Space - Shageluk AVEC Tank Farm](#)

The ITB Due date is hereby changed to February 3, 2026 at 2 PM AKST.

END OF ADDENDUM #01

(3) FOR PO# 133530, US1216 TO US1218 & (10) FOR PO# 133531, US1219 TO US1228



CUSTOMER:	ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)		P.O. #	133530 & 133531	TANK #	(13) US1216 TO US1228
	TITLE: SIDE VIEW					
	FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL SINGLE WALL TANK (UL142) - DIESEL					
	FILE: 02\02\US1216		DRAWN: JAYDEE		SCALE: $\frac{9}{32} = 1' - 0"$	
	30000 GAL SW ALASKA VILLAGE		DEC 9, 2025		DWG#	US1216
				SHEET	1 OF 17	REV B
REGAL TANKS USA INC. PHONE (360) 707-9948 FAX (360) 707-9949						

W8x35 TOWABLE
SKID ASSEMBLY

100% GALVANIZED ACCESS LADDER
ASSEMBLY & 11FT LONG PLATFORM
ASSEMBLY c/w GALVANIZED BOLTS

SEE DWG. 01 FOR NOZZLE
SIZES & LOCATIONS

1"Ø WATER
DRAW-OFF

DECAL "G"

SUPPORT FOR TANK
SHIPPING/STACKING
(4 REQ. PER TANK)

DECAL "H"

DECAL "J"

27,250 LBS

DECAL "J"

27,250 LBS

LIFTING LUGS
OFFSET 1'-8"
(29,000 LBS)

DECAL "J"

DECAL "J"

DECAL "K"

DECAL "L"

DECAL "N"

DECAL "H"

DECAL "G"

DECAL "O"

DECAL "M"

DECAL "P"

3"Ø FLG.

1"Ø-300#
RF.SO. FLG.

1"Ø SCH.80
PIPE

4"Ø FTP c/w
4"x3" BUSHING

1"Ø-90° LR.
SCH.80 BUTT
ELBOW

TYP. BUTT ELBOW

3"Ø HOLE
(B/S)

3"Ø SCH.40 PIPE
c/w SLOTS @ 12"
STAGGERED

4"Ø SCH.40 PIPE
x 3" LONG

GAUGE CLOCK PORT
STILLING WELL

3"Ø-150# RF.SO.
FLG. c/w 3"Ø SCH.
80 PIPE x 5 1/2" LONG

3"Ø FLANGE DETAIL

PROVISION FOR 10"Ø
FLG. E-VENT

TYP. ALL FITTINGS

PHOENIX SERIES 2-898-MIN
c/w 4"x4" REPAD

1"x16"Ø REPAD

1"x8"Ø REPAD

4"Ø

3"Ø

2"Ø

4"

















2"

1"x6"Ø REPAD

TYPICAL PIPE SCULLY FLANGE:

- 2"Ø FPT (G0819M-200) c/w 2"Ø PLUG (G1600M-200)
- 3"Ø FPT (G0819M-300) c/w 2"Ø PLUG (G1600M-300)
- 4"Ø FPT (G0819M-400) c/w 2"Ø PLUG (G1600M-400)


CUSTOMER: ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)		P.O. # 133530 & 133531	TANK # (13) US1216 TO US1228
		TITLE: TOP VIEW & FITTING DETAILS	
		FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL SINGLE WALL TANK (UL142) - DIESEL	
FILE: 02\02\US1216 30000 GAL SW ALASKA VILLAGE		DRAWN: JAYDEE DEC 9, 2025	SCALE: 5/16"=1'-0"
		DWG# US1216 SHEET 3 OF 17	REV B
REGAL TANKS USA INC. PHONE (360) 707-9948 FAX (360) 707-9949			

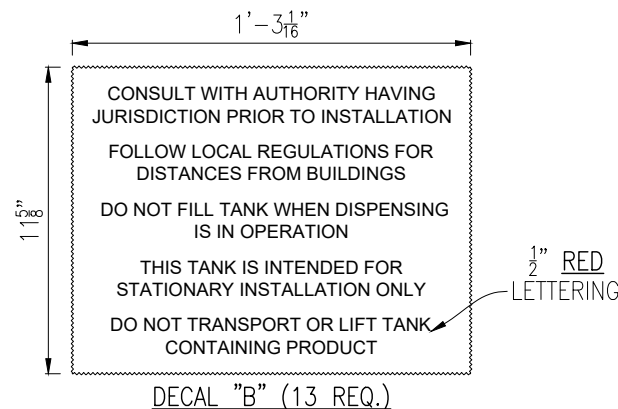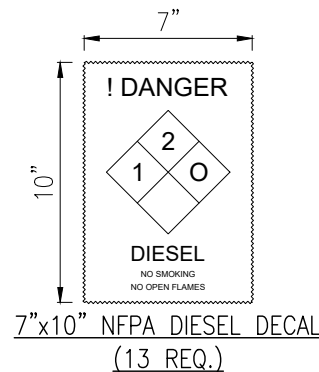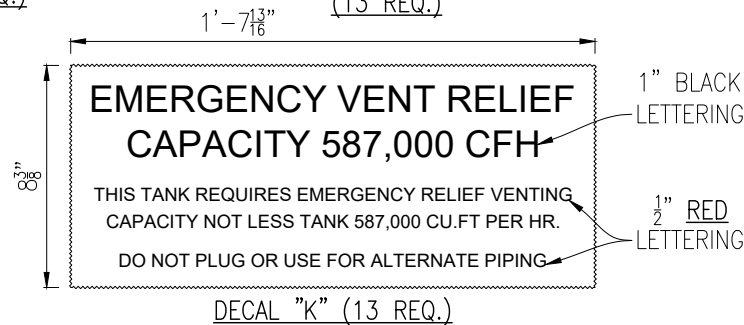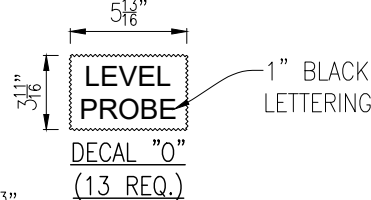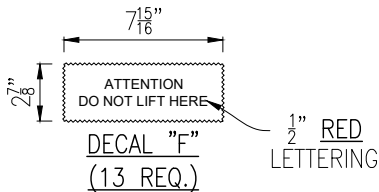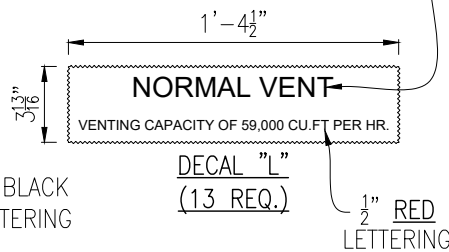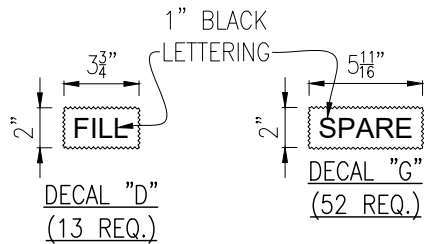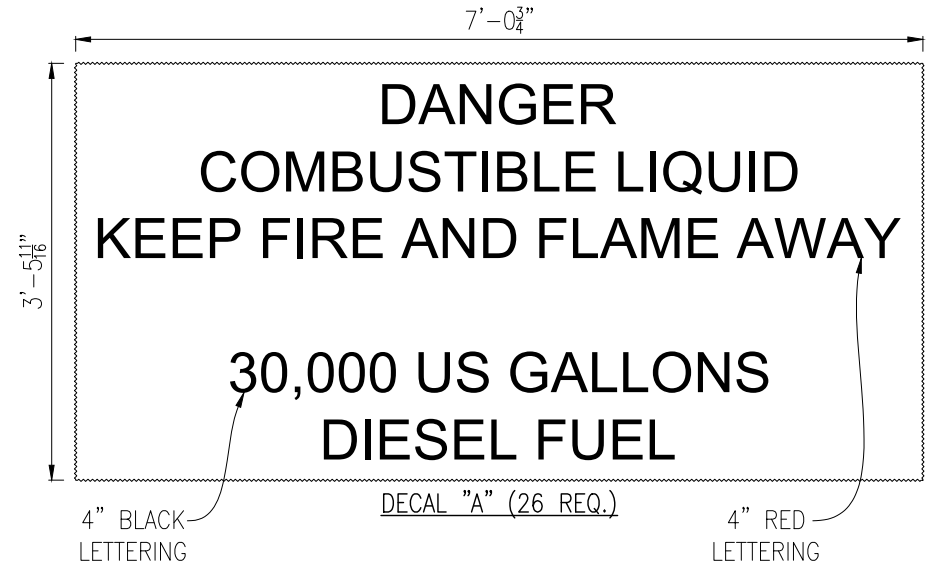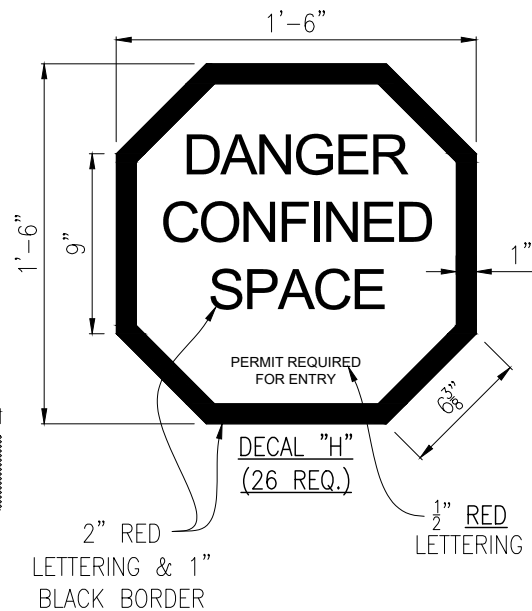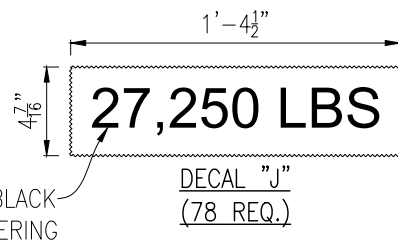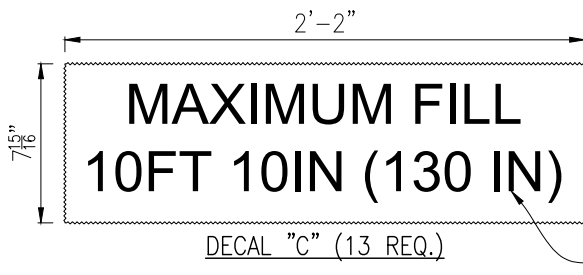

- SHIPPED LOOSE NOTE FOR TEN TANKS:
- (13) 2"Ø CLOSE NIPPLE c/w 2"Ø MORRISON FIG.178 IRON CAP
 - (13) 14FT DIP STICKS
 - (13) GALVANIZED LADDER & PLATFORM ASSEMBLIES c/w GALVANIZED BOLTING HARDWARE
 - TOUCH UP PAINT: ONE GALLON EACH OF CATHACAT 302H (GREEN), BAR-RUST 236 (GREY), BAR-RUST 236 (OFF-WHITE), DEVTHANE 379 (WHITE)
 - STACKING/SHIPPING HARDWARE: (208) 3/4"x10 3/4" BOLTS c/w NUTS & WASHERS, (104) 1/2" STACKING "CLAMP" PLATE

CUSTOMER:	ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)	P.O. #	133530 & 133531	TANK #	(13) US1216 to US1228
					
TITLE: DECAL DETAILS & SHIPPED LOOSE NOTE					
FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL SINGLE WALL TANK (UL142) - DIESEL					
FILE: 02\02\US1216 30000 GAL SW ALASKA VILLAGE		DRAWN: JAYDEE DEC 9, 2025		SCALE: N/A	DWG# US1216 SHEET 4 OF 17
REV B					
REGAL TANKS USA INC. PHONE (360) 707-9948 FAX (360) 707-9949					

(2) TWO GASOLINE TANKS REQ FOR PO# 133531, US1229 TO US1230

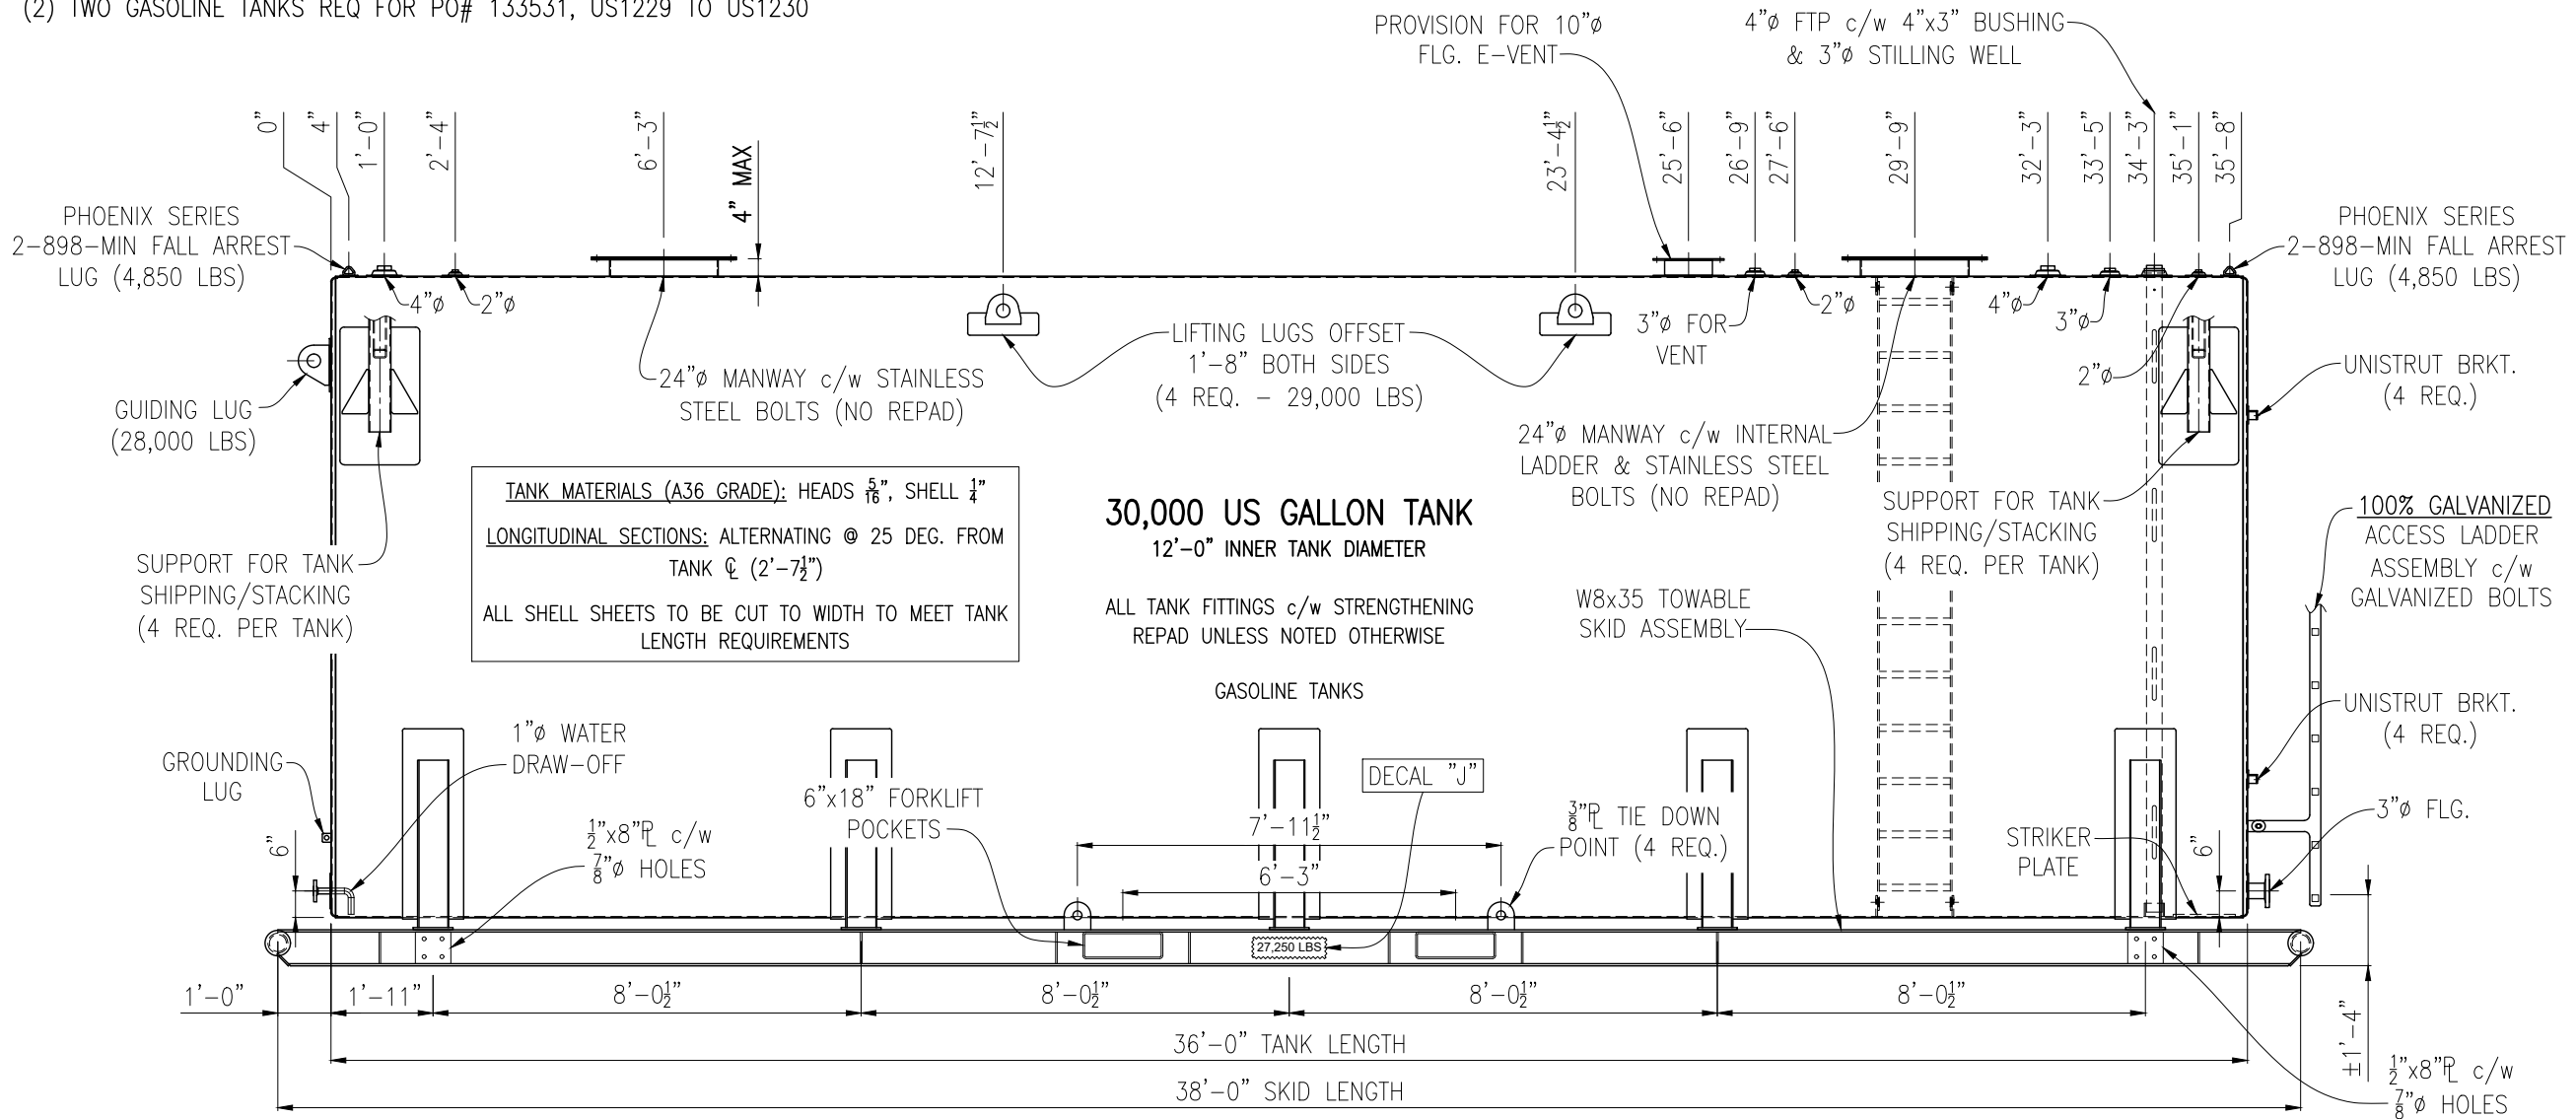

EMPTY SHIPPING WEIGHT: 27,250 LBS

PAINT NOTES:

SANDBLAST EXTERIOR TO SSPC-SP10 & APPLY ONE COAT OF CATHACAT 302H (2-3 mils DFT), TWO COATS OF BAR-RUST 236 (6-8 mils DFT EA. / 12-16 mils DFT TOTAL) & ONE COAT OF WHITE DEVTHANE 379 (3-4 mils DFT)



SUFFICIENTLY CONTRASTING COLOURS BETWEEN COATS TO ENSURE COMPLETE COVERAGE

TYPICAL MATERIAL GRADE:

- WIDE FLANGE - A992/A572-50
- PIPE - A53 GR B
- HOLLOW STRUCTURAL STEEL TUBING - CSA 40.21 50W
- ANGLE - ASTM A36/44W
- FLAT BAR - ASTM A36/44W
- STEEL PLATE - ASTM A36 OR A36/44W DUEL CERT.



B	DEC 17, 2025	REVISED NOTATION AS PER MARKUP & ADDED ADDITIONAL TANKS	JM	JS
REV	DATE	DESCRIPTION	DRAWN BY	APPROVED BY

CUSTOMER: ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)		P.O. # 133531	TANK # (2) US1229 & US1230	
		TITLE: SIDE VIEW		
		FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL SINGLE WALL TANK (UL142) - GASOLINE		
FILE: 02\02\US1216 30000 GAL SW ALASKA VILLAGE		DRAWN: JAYDEE DEC 9, 2025	SCALE: 9/32"=1'-0"	DWG# US1216 REV B SHEET 5 OF 17
REGAL TANKS USA INC. PHONE (360) 707-9948 FAX (360) 707-9949				

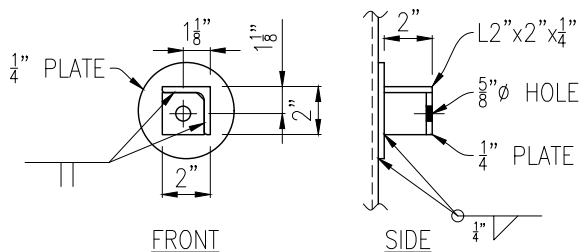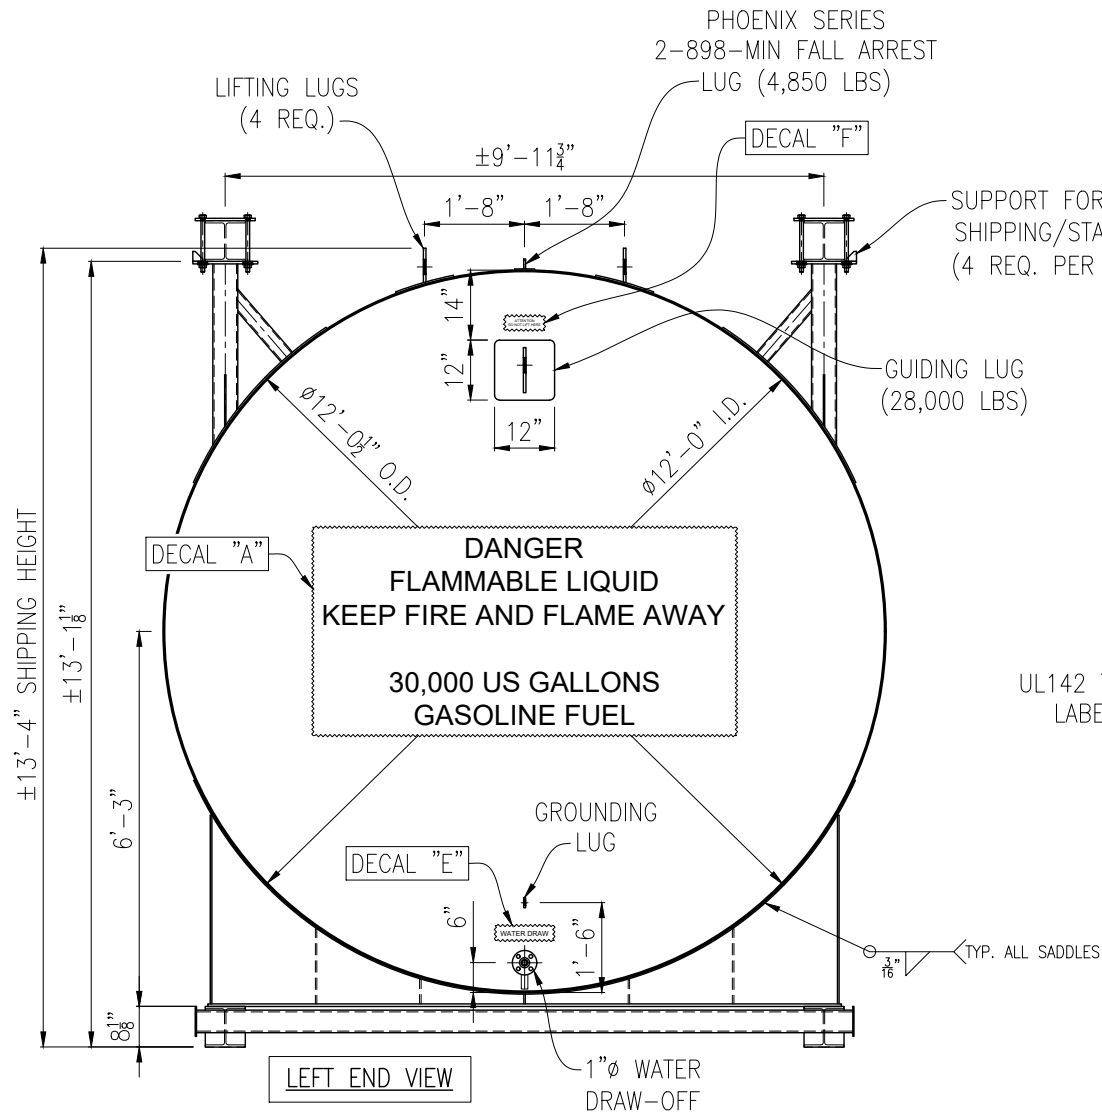

UNISTRUT BRACKET DETAIL
(4 REQ. PER TANK)

LONGITUDINAL SHELL JOINTS (AS PER UL142)
ALTERNATING @ 25 DEG. FROM TANK C

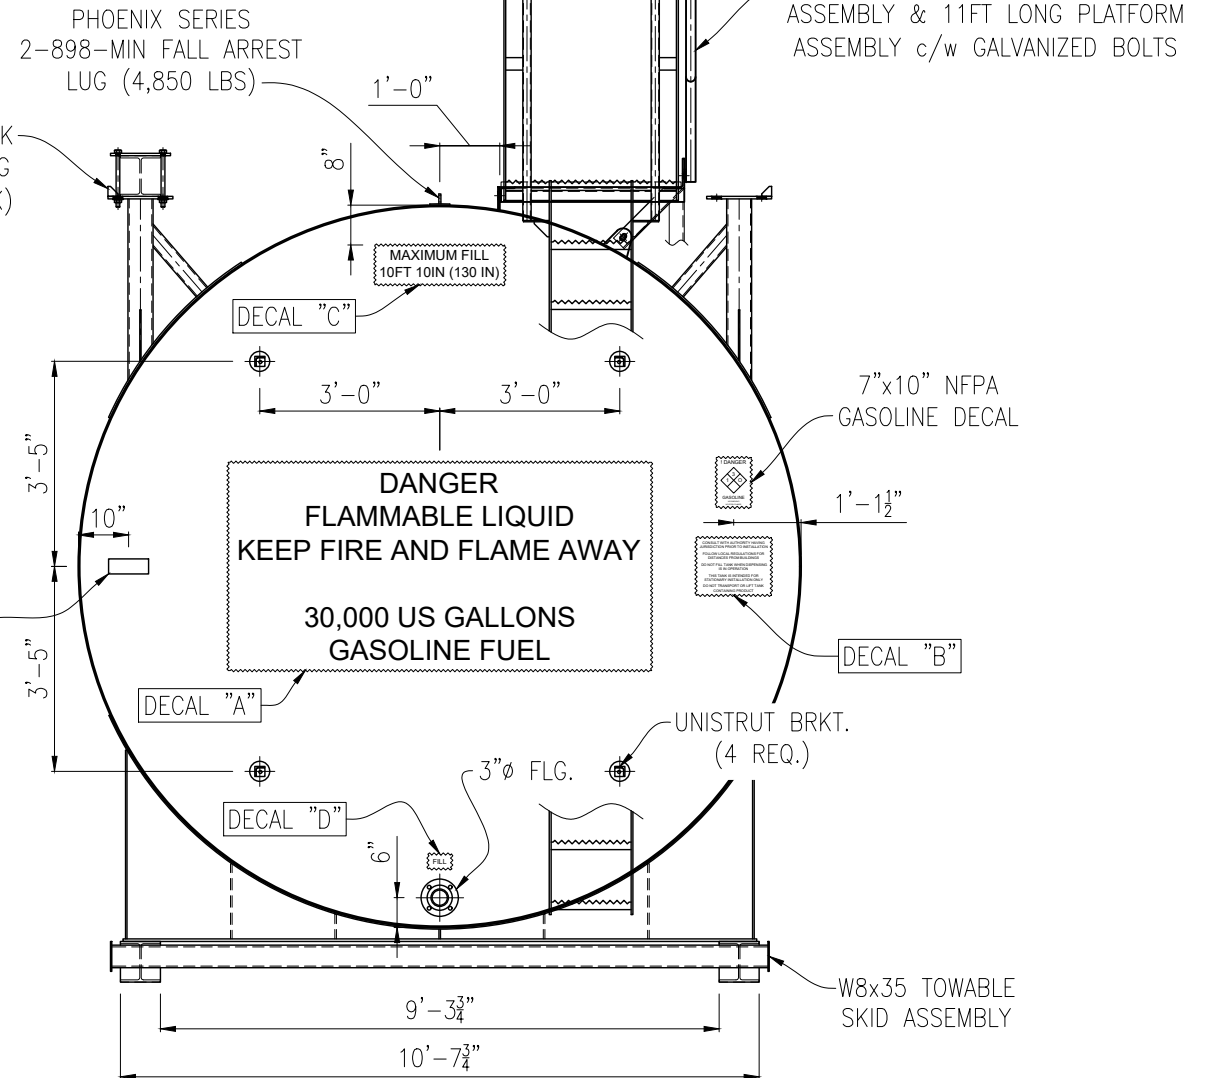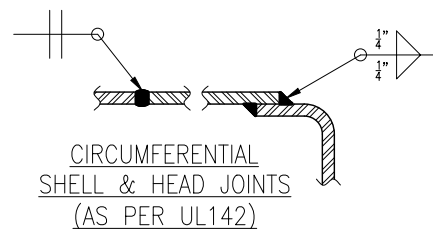

RIGHT END VIEW

CUSTOMER: ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)		P.O. # 133531	TANK # (2) US1229 & US1230	
		TITLE: LEFT & RIGHT END VIEWS		
		FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL SINGLE WALL TANK (UL142) - GASOLINE		
		FILE: 02\02\US1216 30000 GAL SW ALASKA VILLAGE	DRAWN: JAYDEE DEC 9, 2025	SCALE: 5/16" = 1'-0"
REV B				
REGAL TANKS USA INC. PHONE (360) 707-9948 FAX (360) 707-9949				

W8x35 TOWABLE
SKID ASSEMBLY

100% GALVANIZED ACCESS LADDER
ASSEMBLY & 11FT LONG PLATFORM
ASSEMBLY c/w GALVANIZED BOLTS

SEE DWG. 05 FOR NOZZLE
SIZES & LOCATIONS

1"Ø WATER
DRAW-OFF

DECAL "G"

SUPPORT FOR TANK
SHIPPING/STACKING
(4 REQ. PER TANK)

DECAL "H"

DECAL "J"

27,250 LBS

DECAL "J"

27,250 LBS

LIFTING LUGS
OFFSET 1'-8"
(29,000 LBS)

DECAL "J"

DECAL "J"

DECAL "K"

DECAL "L"

DECAL "G"

DECAL "O"

DECAL "M"

DECAL "P"

3"Ø FLG.

1"Ø-300#
RF.SO. FLG.

1"Ø SCH.80
PIPE

4"Ø FTP c/w
4"x3" BUSHING

1"Ø-90° LR.
SCH.80 BUTT
ELBOW

3"Ø HOLE
(B/S)

GAUGE CLOCK PORT
STILLING WELL

3"Ø-150# RF.SO.
FLG. c/w 3"Ø SCH.
80 PIPE x 5 1/2" LONG

3"Ø FLANGE DETAIL

PROVISION FOR 10"Ø
FLG. E-VENT

PHOENIX SERIES 2-898-MIN
c/w 4"x4" REPAD

















TYP. ALL FITTINGS

4" MAX.

TYPICAL PIPE SCULLY FLANGE:

- 2"Ø FPT (G0819M-200) c/w 2"Ø PLUG (G1600M-200)
- 3"Ø FPT (G0819M-300) c/w 2"Ø PLUG (G1600M-300)
- 4"Ø FPT (G0819M-400) c/w 2"Ø PLUG (G1600M-400)

CUSTOMER: ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)		P.O. # 133531	TANK # (2) US1229 & US1230
TITLE: TOP VIEW & FITTING DETAILS			
FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL SINGLE WALL TANK (UL142) - GASOLINE			
FILE: 02\02\US1216 30000 GAL SW ALASKA VILLAGE		DRAWN: JAYDEE DEC 9, 2025	SCALE: 5/16"=1'-0"
DWG# US1216 SHEET 7 OF 17		REV B	
REGAL TANKS USA INC. PHONE (360) 707-9948 FAX (360) 707-9949			

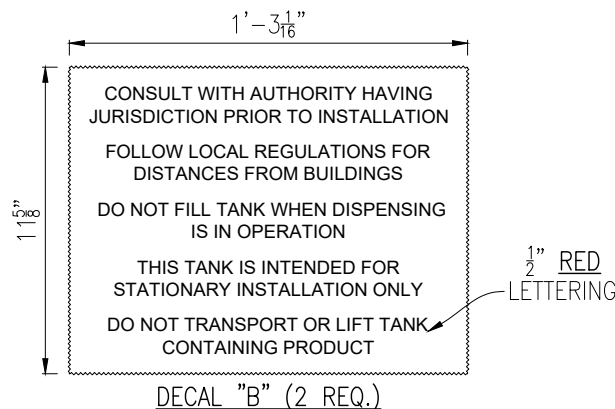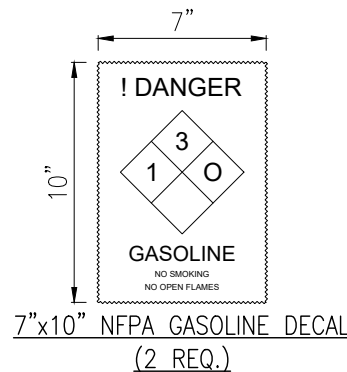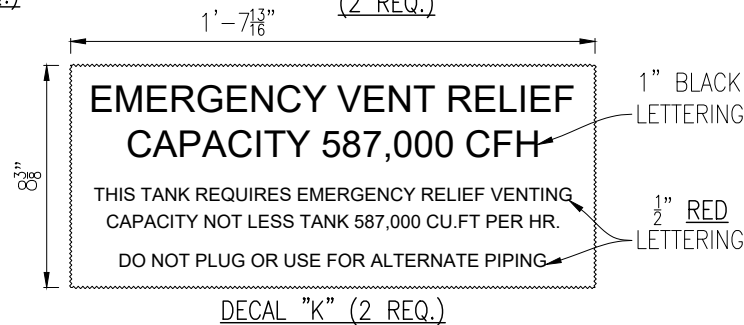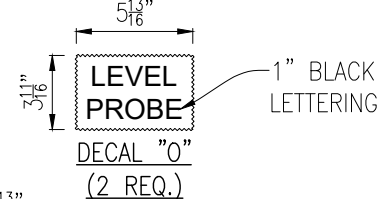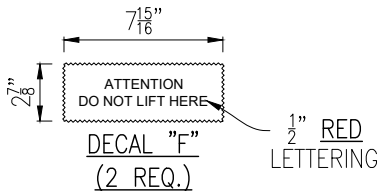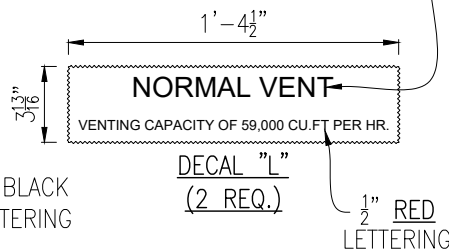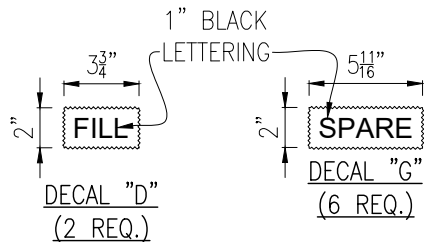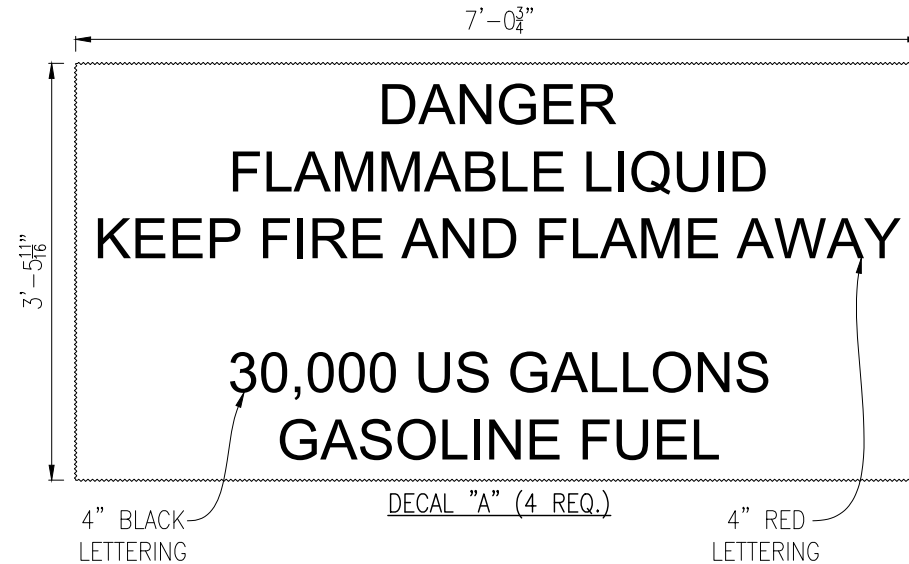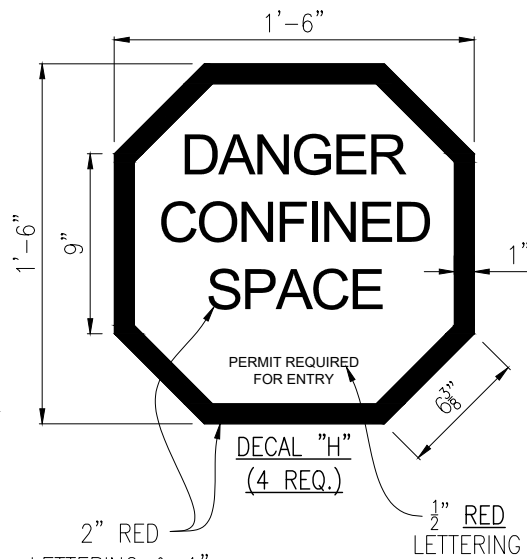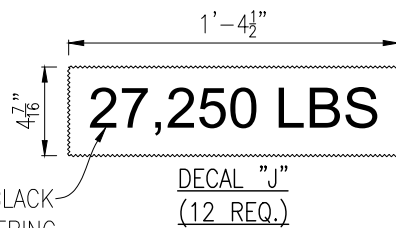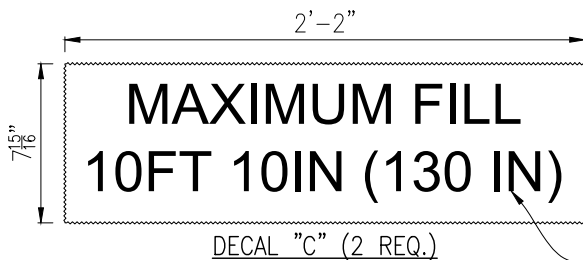

- SHIPPED LOOSE NOTE FOR TWO TANKS:
- (2) 2"Ø CLOSE NIPPLE c/w 2"Ø MORRISON FIG.178 IRON CAP
 - (2) 14FT DIP STICKS
 - (2) GALVANIZED LADDER & PLATFORM ASSEMBLIES c/w GALVANIZED BOLTING HARDWARE
 - STACKING/SHIPPING HARDWARE: (32) 3/4"x10 3/4" BOLTS c/w NUTS & WASHERS, (16) 1/2" STACKING "CLAMP" PLATE

CUSTOMER:	ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)	P.O. #	133531	TANK #	(2) US1229 & US1230
					
TITLE: DECAL DETAILS & SHIPPED LOOSE NOTE					
FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL SINGLE WALL TANK (UL142) - GASOLINE					
FILE: 02\02\US1216 30000 GAL SW ALASKA VILLAGE		DRAWN: JAYDEE DEC 9, 2025		SCALE: N/A	DWG# US1216 SHEET 8 OF 17
REV B					
REGAL TANKS USA INC. PHONE (360) 707-9948 FAX (360) 707-9949					

100% GALVANIZED ACCESS LADDER
ASSEMBLY & 11FT LONG PLATFORM
ASSEMBLY c/w GALVANIZED BOLTS

PHOENIX SERIES
2-898-MIN FALL ARREST
LUG (4,850 LBS)

LIFTING LUGS (4 REQ.)

SUPPORT FOR TANK
SHIPPING/STACKING
(4 REQ. PER TANK)

GUIDING LUG
(28,000 LBS)

7"x10" NFPA
DIESEL DECAL

UL142 TANK
LABEL

DECAL "B"

UNISTRUT BRKT.
(4 REQ.)

3/16" TYP. ALL SADDLES

MAXIMUM FILL
10FT 10IN (130 IN)

DECAL "F"

Ø12'-0" I.D.

Ø12'-0 1/2" O.D.

**DANGER
COMBUSTIBLE LIQUID
KEEP FIRE AND FLAME AWAY**

**15,000 US GALLONS
DIESEL FUEL**

DECAL "A2"

DECAL "D"

GROUNDING
LUG

±13'-4" SHIPPING HEIGHT
±13'-1 1/8"

6'-3"

8 1/8"

LEFT END VIEW

PHOENIX SERIES
2-898-MIN FALL ARREST
LUG (4,850 LBS)

PIPE SUPPORT
BRKT. (16 REQ.)

1'-0"

8"

MAXIMUM FILL
10FT 10IN (130 IN)

DECAL "C"

3'-0" TYP.

3'-0" TYP.

100% GALVANIZED ACCESS LADDER
ASSEMBLY & 11FT LONG PLATFORM
ASSEMBLY c/w GALVANIZED BOLTS

7"x10" NFPA
GASOLINE DECAL

1'-1 1/2"

DECAL "B"

**DANGER
FLAMMABLE LIQUID
KEEP FIRE AND FLAME AWAY**

**15,000 US GALLONS
GASOLINE FUEL**

DECAL "A1"

DECAL "D"

3"Ø FLG.

UNISTRUT BRKT.
(4 REQ.)


W8x35 TOWABLE
SKID ASSEMBLY

3'-5" TYP.
3'-5" TYP.


RIGHT END VIEW

9'-3 3/4"

10'-7 3/4"






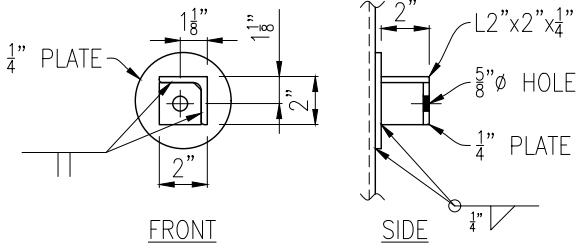


UNISTRUT BRACKET
DETAIL (8 REQ.)

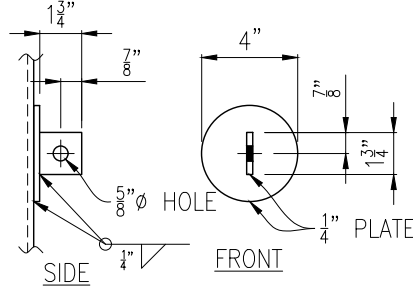

PIPE SUPPORT BRACKET
DETAIL (16 REQ.)


CUSTOMER: ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)		P.O. # 133530	TANK # (1) US1231	
				
TITLE: LEFT & RIGHT END VIEWS				
FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL 2-WAY SPLIT (15K/15K) SINGLE WALL TANK (UL142)				
FILE: 02\02\US1216 30000 GAL SW ALASKA VILLAGE	DRAWN: JAYDEE DEC 9, 2025	SCALE: 5/16"=1'-0"	DWG# US1216 SHEET 10 OF 17	REV B
REGAL TANKS USA INC. PHONE (360) 707-9948 FAX (360) 707-9949				

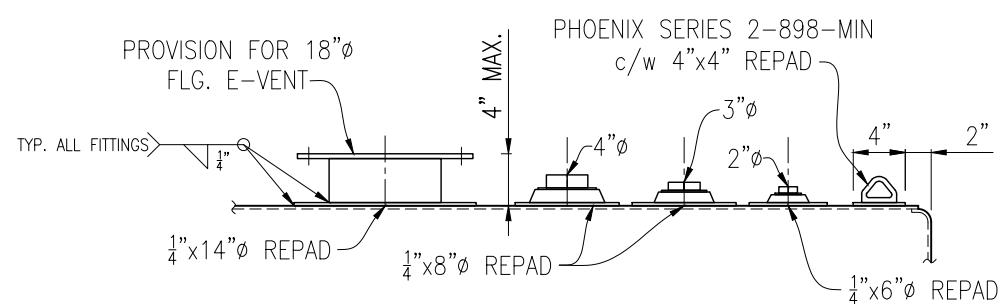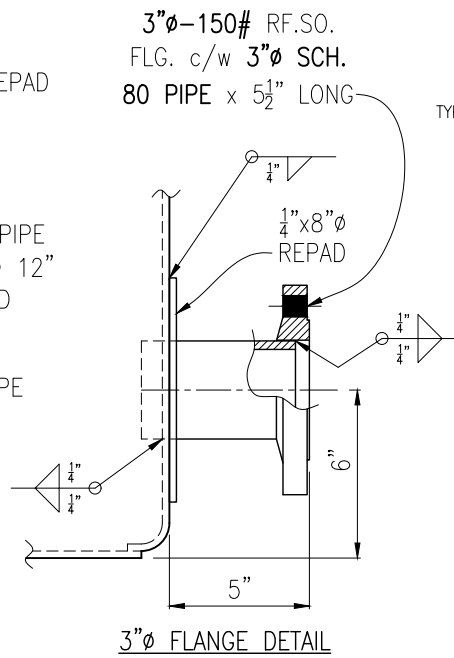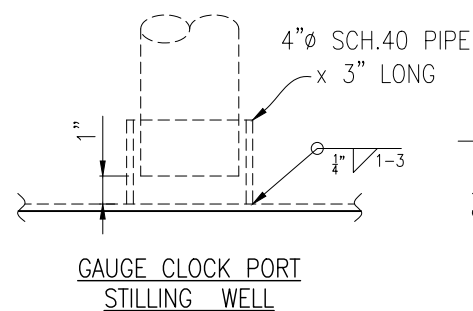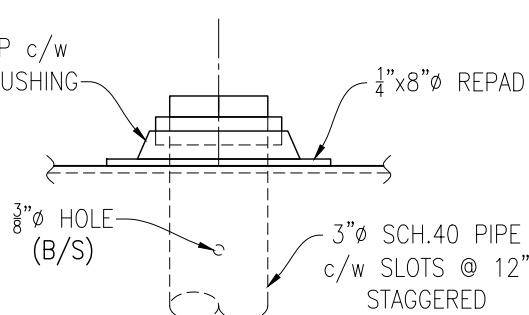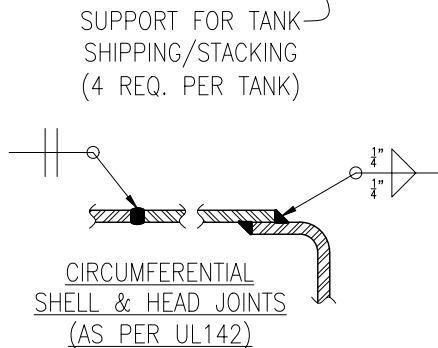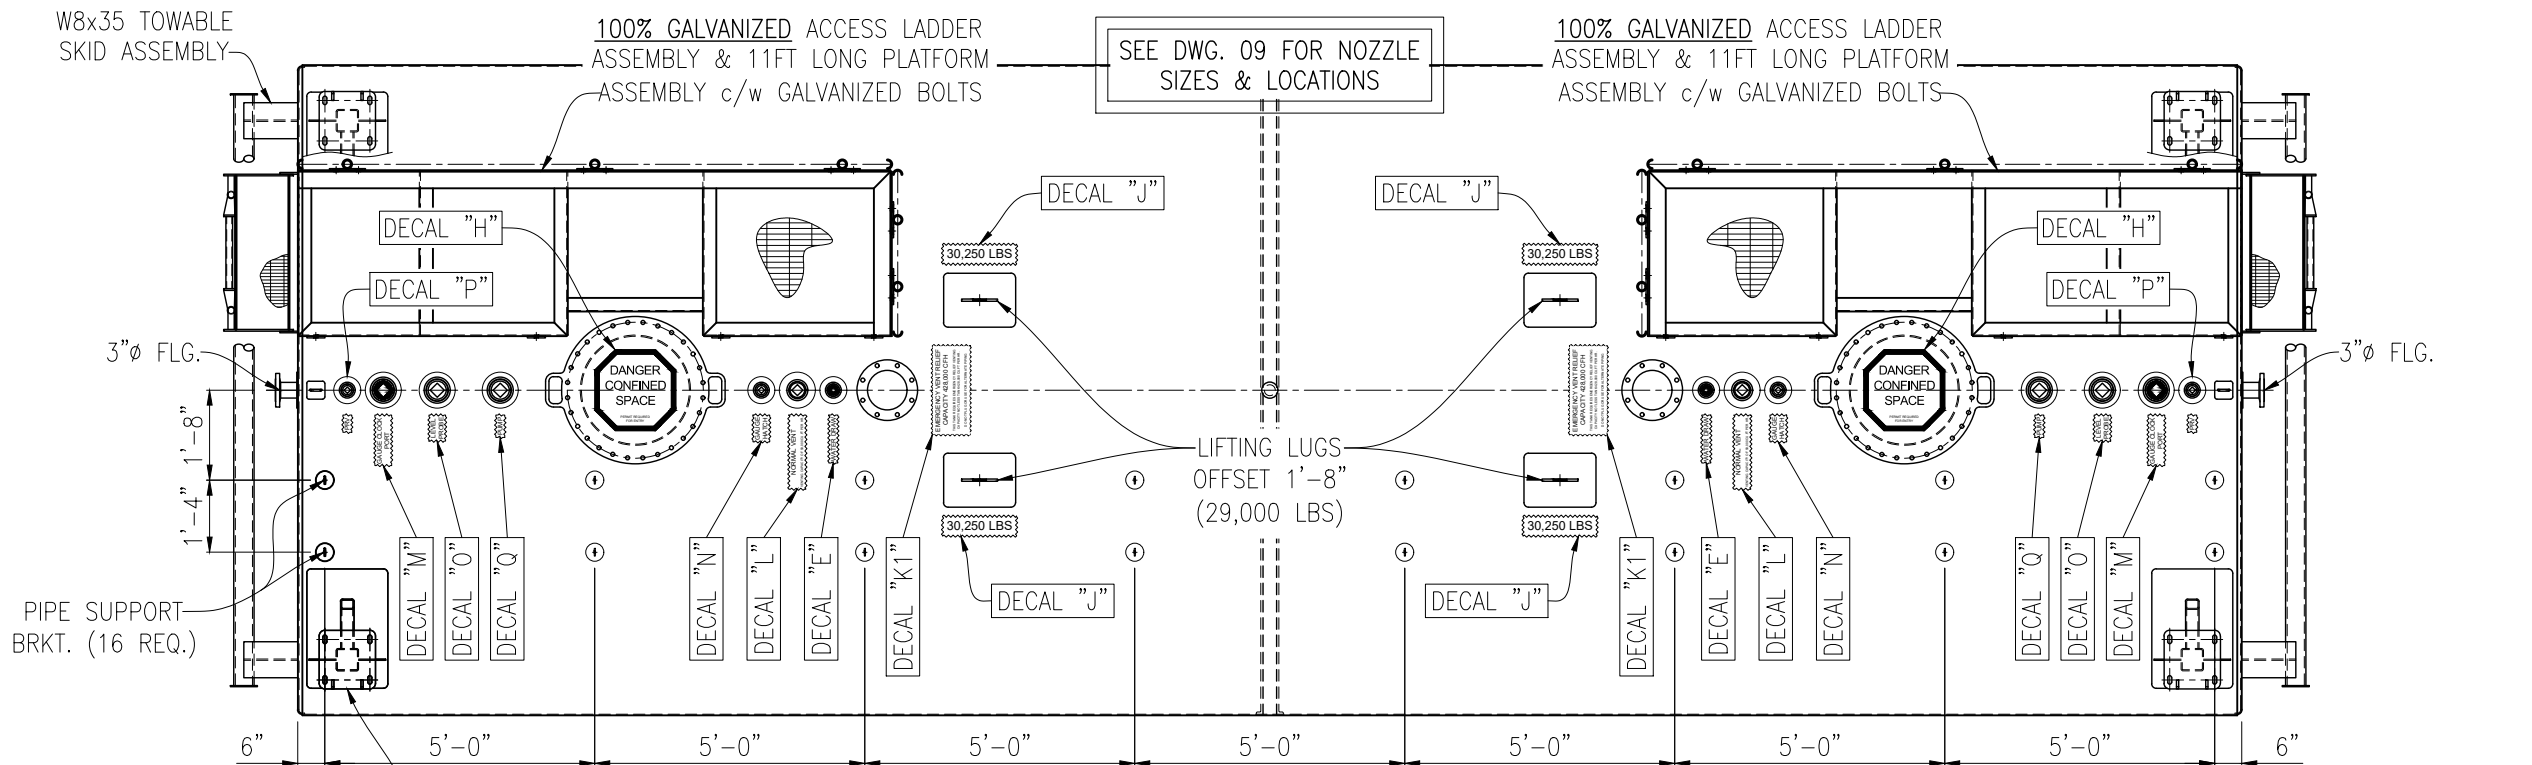


- TYPICAL PIPE SCULLY FLANGE:**
- 2"Ø FPT (G0819M-200) c/w 2"Ø PLUG (G1600M-200)
 - 3"Ø FPT (G0819M-300) c/w 2"Ø PLUG (G1600M-300)
 - 4"Ø FPT (G0819M-400) c/w 2"Ø PLUG (G1600M-400)

LONGITUDINAL SHELL JOINTS (AS PER UL142)
ALTERNATING @ 25 DEG. FROM TANK C

CUSTOMER: ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)		P.O. # 133530	TANK # (1) US1231
TITLE: TOP VIEW & FITTING DETAILS			
FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL 2-WAY SPLIT (15K/15K) SINGLE WALL TANK (UL142)			
FILE: 02\02\US1216 30000 GAL SW ALASKA VILLAGE	DRAWN: JAYDEE DEC 9, 2025	SCALE: 5/16"=1'-0"	DWG# US1216 SHEET 11 OF 17
 REGAL TANKS USA INC. PHONE (360) 707-9948 FAX (360) 707-9949			

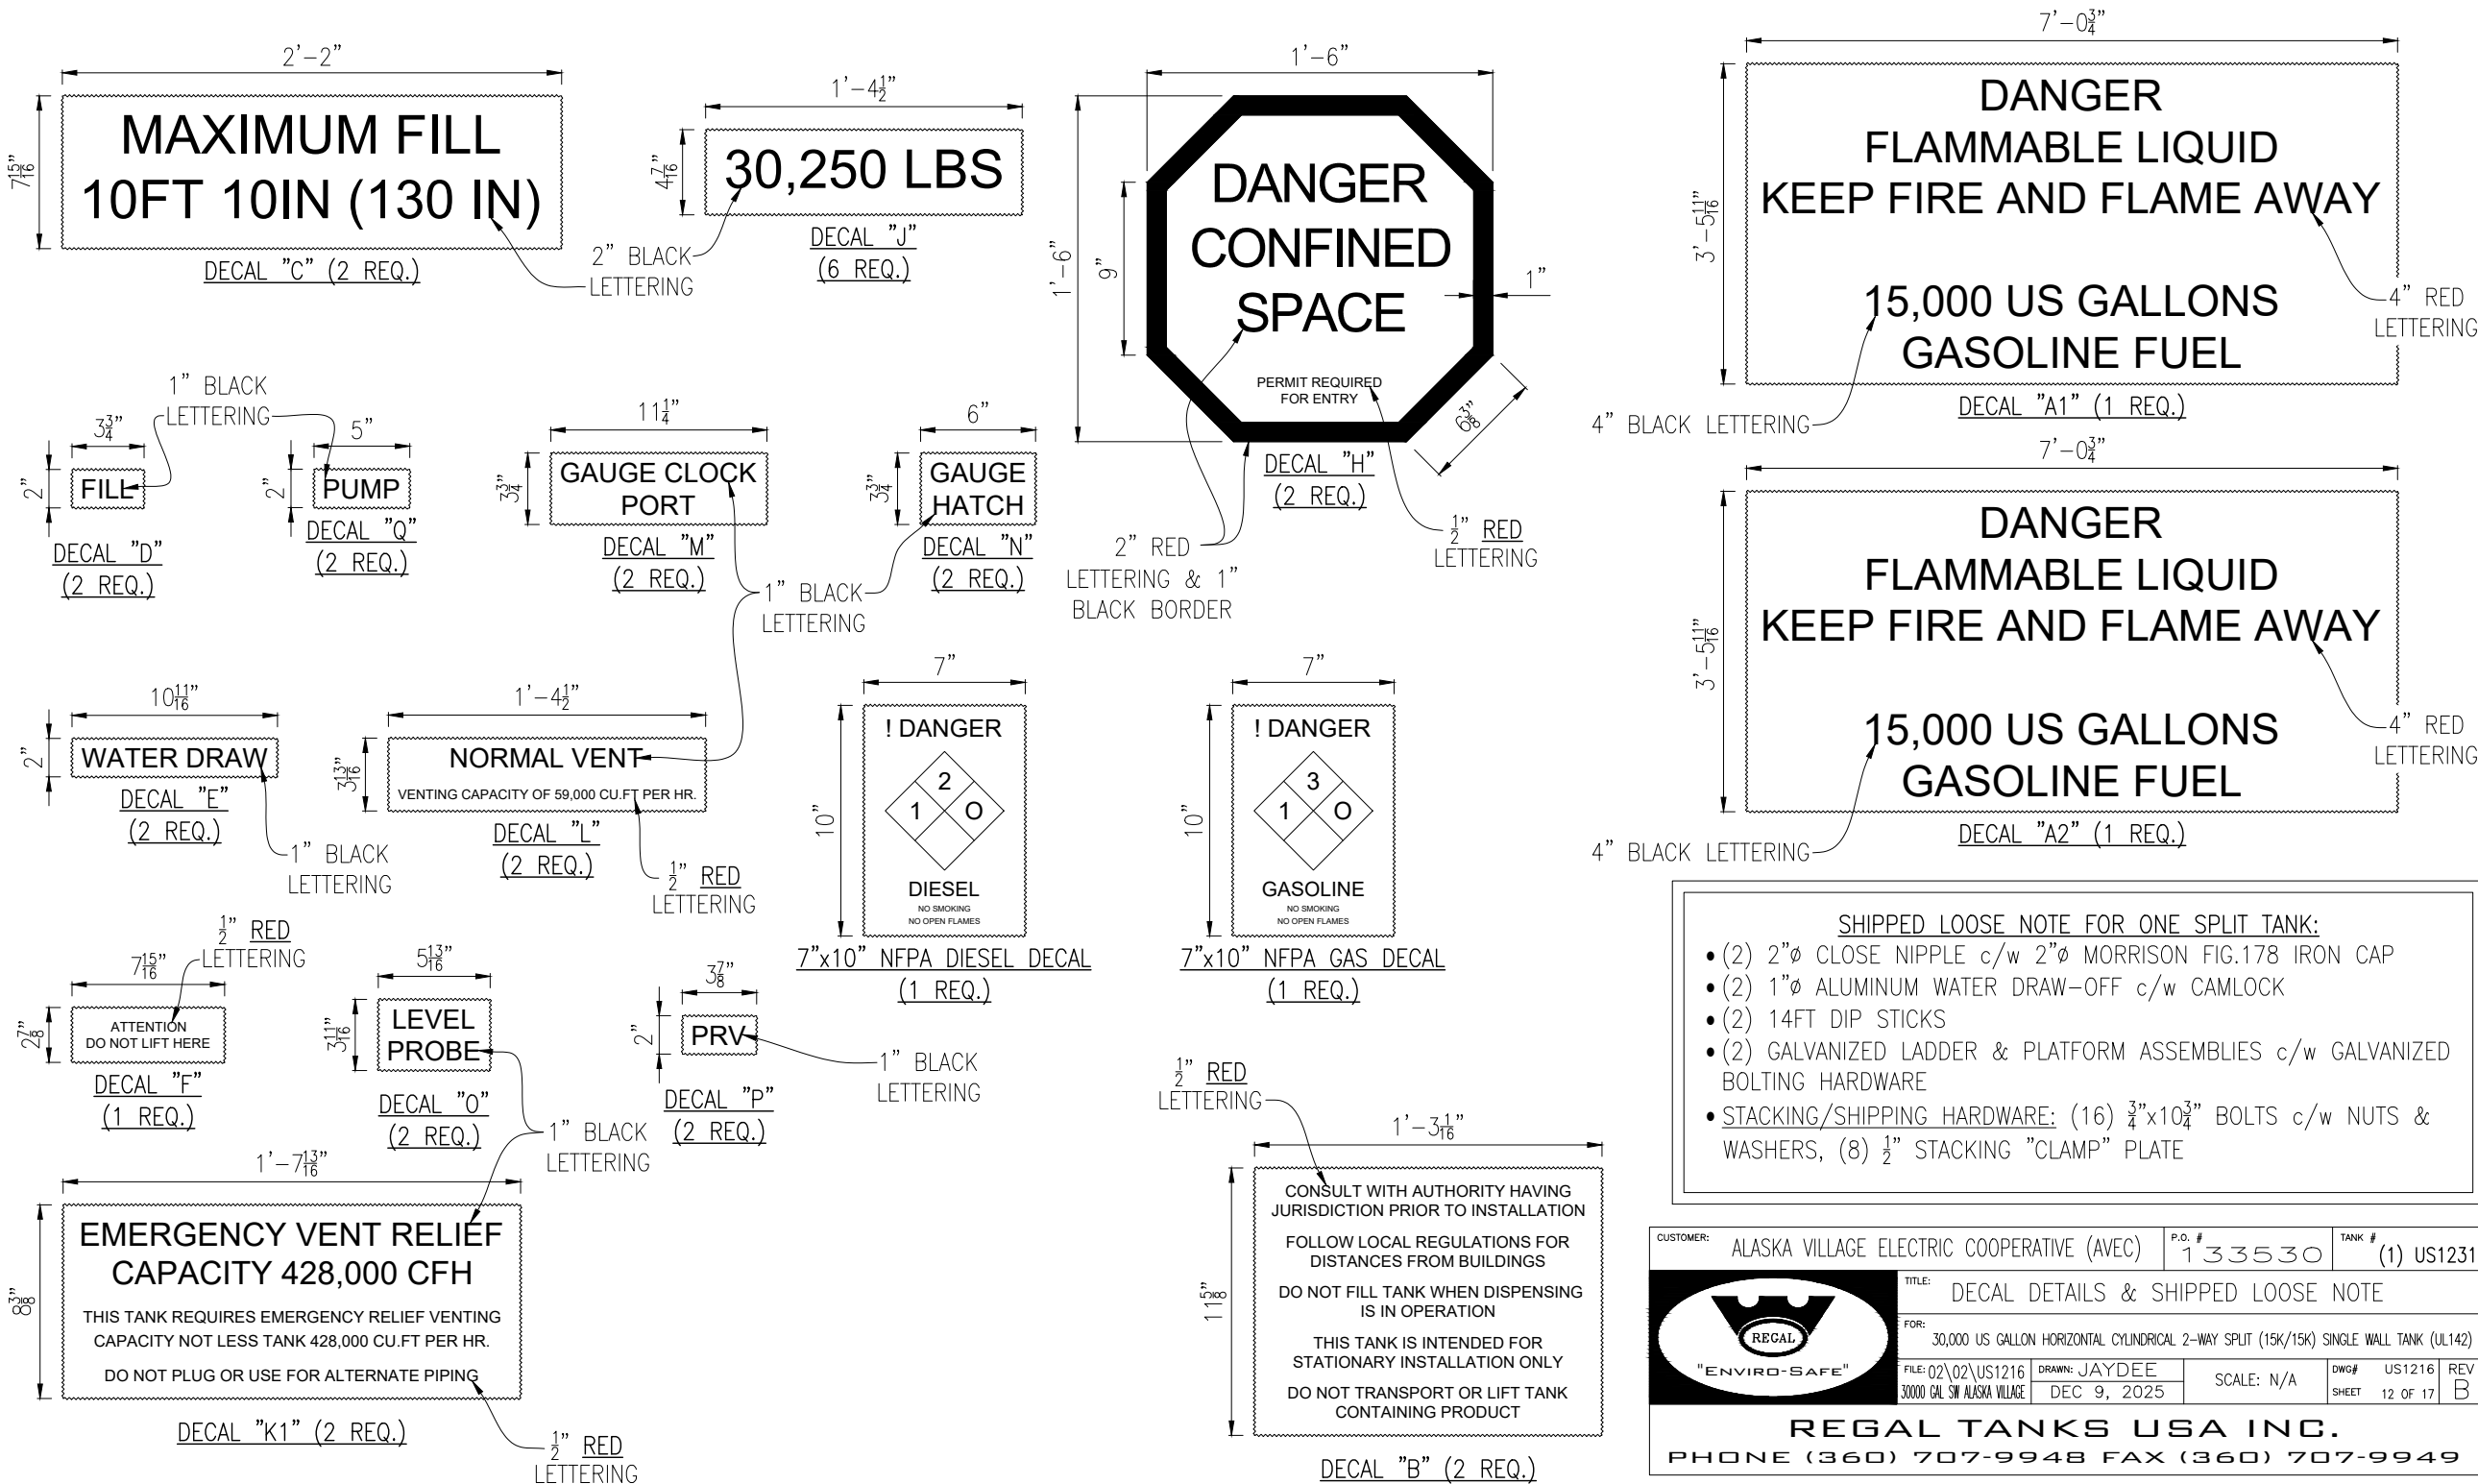

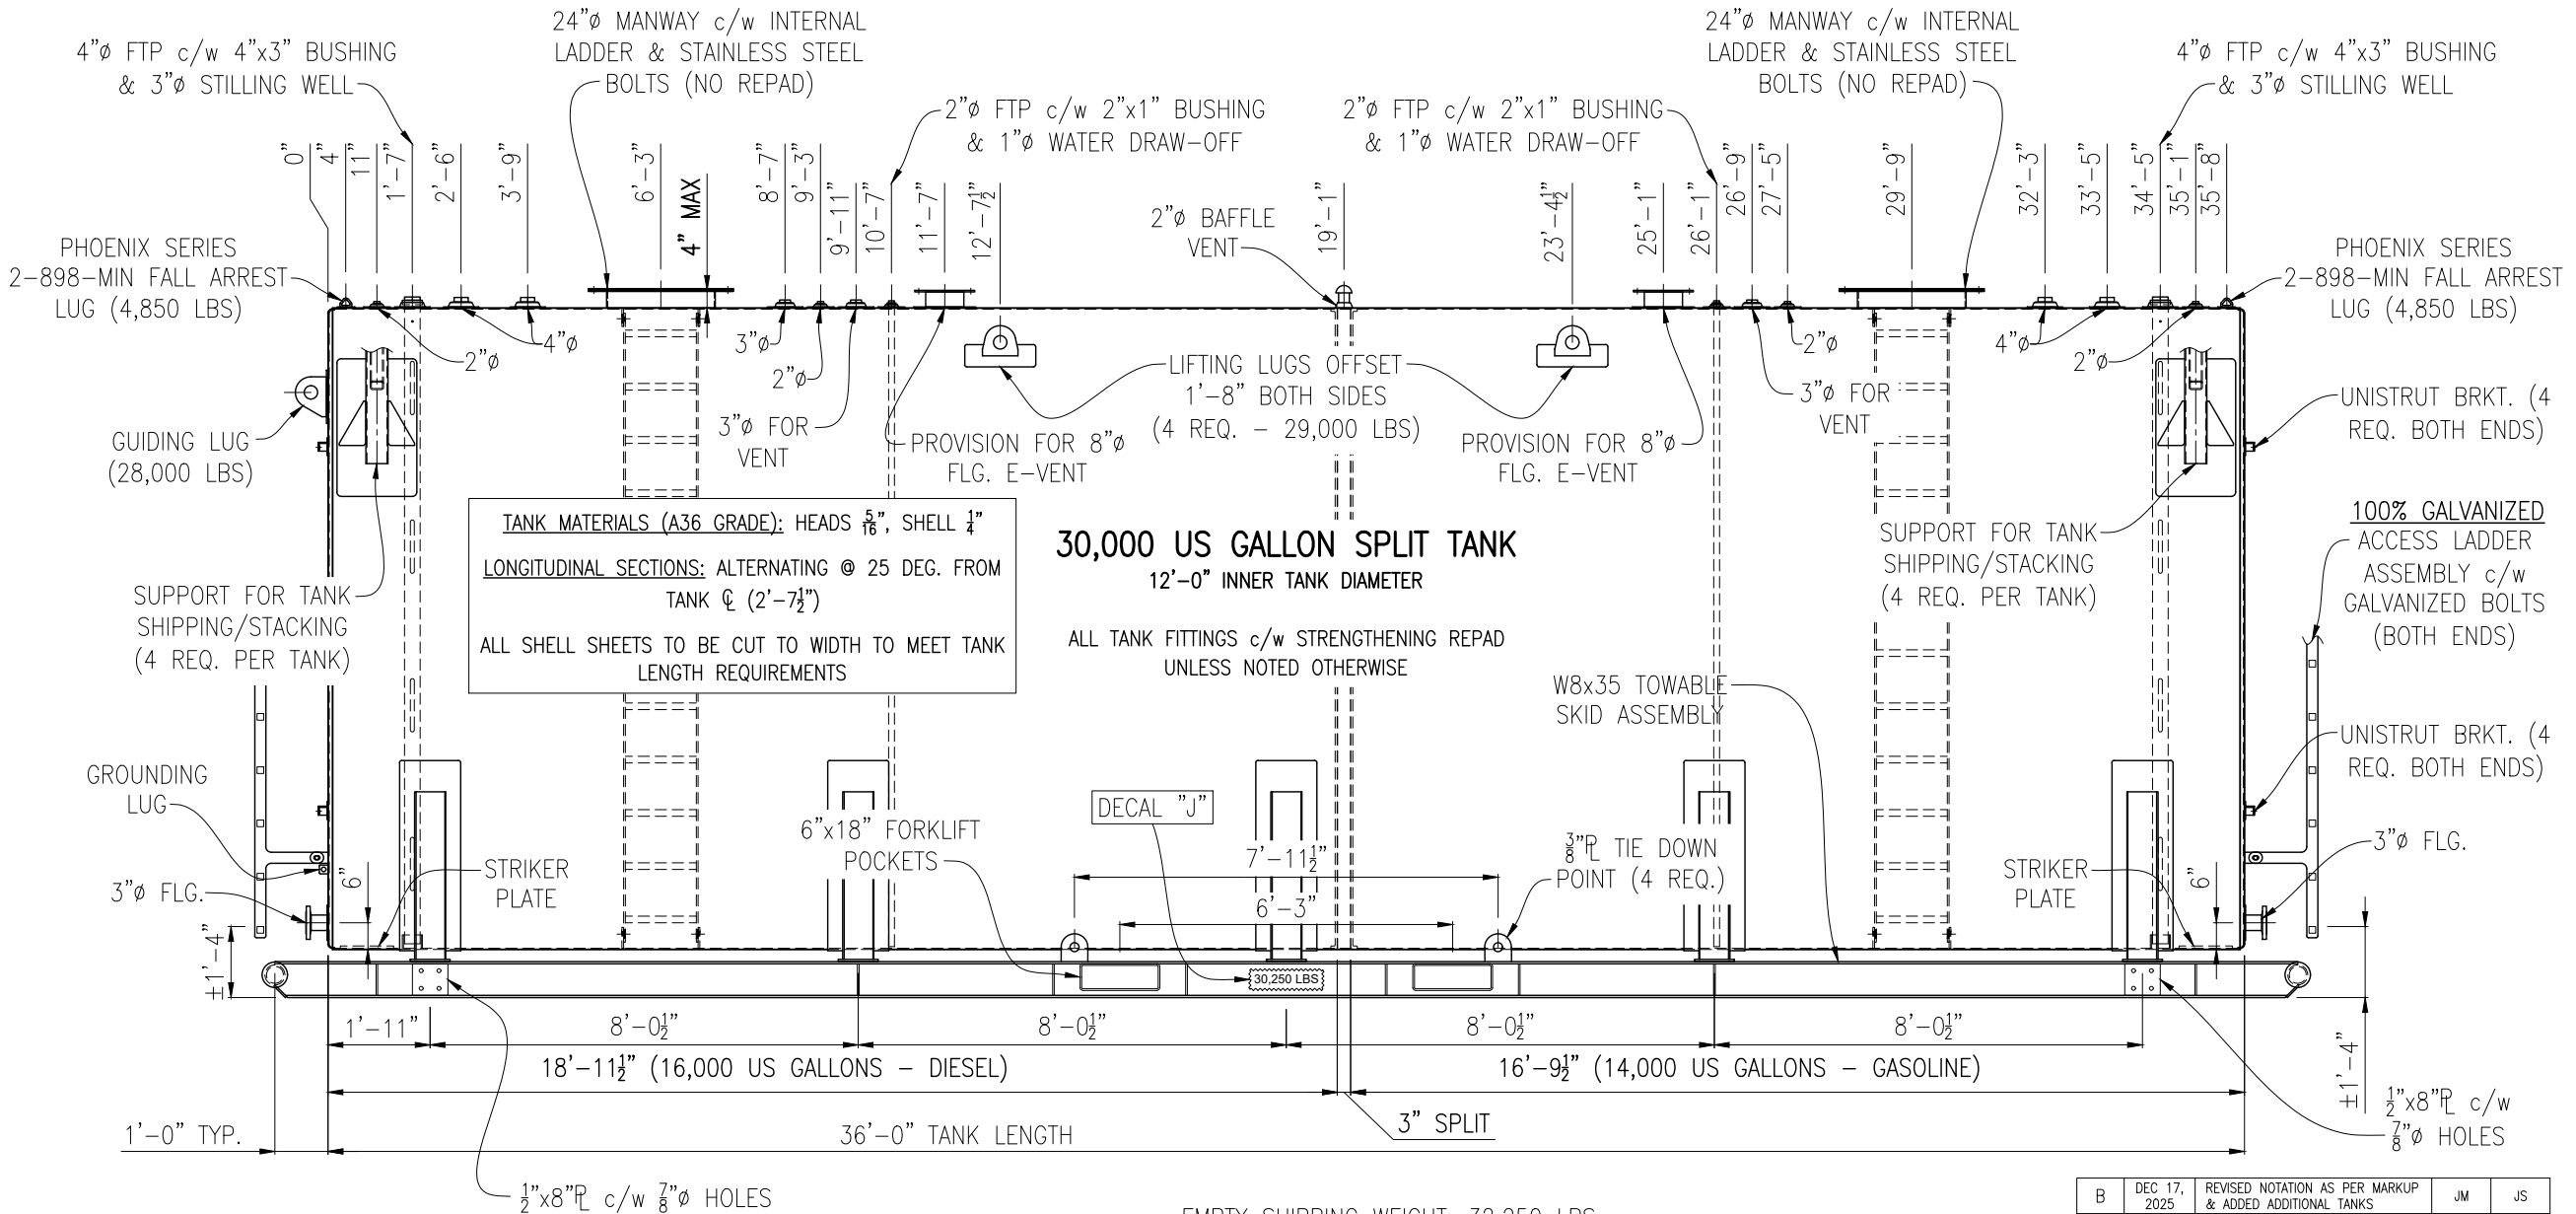

EMPTY SHIPPING WEIGHT: 32,250 LBS

PAINT NOTES:

SANDBLAST EXTERIOR TO SSPC-SP10 & APPLY ONE COAT OF CATHACAT 302H (2-3 mils DFT), TWO COATS OF BAR-RUST 236 (6-8 mils DFT EA. / 12-16 mils DFT TOTAL) & ONE COAT OF WHITE DEVTHANE 379 (3-4 mils DFT)

SUFFICIENTLY CONTRASTING COLOURS BETWEEN COATS TO ENSURE COMPLETE COVERAGE

TYPICAL MATERIAL GRADE:

- WIDE FLANGE - A992/A572-50
- PIPE - A53 GR B
- HOLLOW STRUCTURAL STEEL TUBING - CSA 40.21 50W
- ANGLE - ASTM A36/44W
- FLAT BAR - ASTM A36/44W
- STEEL PLATE - ASTM A36 OR A36/44W DUEL CERT.

B	DEC 17, 2025	REVISED NOTATION AS PER MARKUP & ADDED ADDITIONAL TANKS	JM	JS
REV	DATE	DESCRIPTION	DRAWN BY	APPROVED BY

CUSTOMER:	ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)	P.O. #	133530	TANK #	(1) US1232
		TITLE: SIDE VIEW			
FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL 2-WAY SPLIT (14K/16K) SINGLE WALL TANK (UL142)					
FILE: 02\02\US1216 30000 GAL SW ALASKA VILLAGE		DRAWN: JAYDEE DEC 9, 2025		SCALE: 3/8" = 1'-0"	
DWG# US1216 SHEET 13 OF 17		REV B			
REGAL TANKS USA INC.					
PHONE (360) 707-9948 FAX (360) 707-9949					

UNISTRUT BRACKET
DETAIL (8 REQ.)

PIPE SUPPORT BRACKET
DETAIL (16 REQ.)

ASSEMBLY 3/16/04

PIPE SUPPORT BRKT. (16 REQ.)

1'-0"

8"

MAXIMUM FILL 10FT 10IN (130 IN)

DECAL "C"

3'-0" TYP.

3'-0" TYP.

7"x10" NFPA GASOLINE DECAL

1'-1 1/2"

DECAL "B"

UNISTRUT BRKT. (4 REQ.)

3"Ø FLG.

6"

DECAL "D"

9'-3 3/4"

10'-7 3/4"

W8x35 TOWABLE SKID ASSEMBLY

3'-5" TYP.







10"

DANGER FLAMMABLE LIQUID
KEEP FIRE AND FLAME AWAY
14,000 US GALLONS
GASOLINE FUEL

DECAL "A1"

RIGHT END VIEW


CUSTOMER: ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)		P.O. # 133530	TANK # (1) US1232	
		TITLE: LEFT & RIGHT END VIEWS		
		FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL 2-WAY SPLIT (14K/16K) SINGLE WALL TANK (UL142)		
		FILE: 02\02\US1216 30000 GAL SW ALASKA VILLAGE	DRAWN: JAYDEE DEC 9, 2025	SCALE: $\frac{5}{16}'' = 1'-0''$
REGAL TANKS USA INC. PHONE (360) 707-9948 FAX (360) 707-9949				

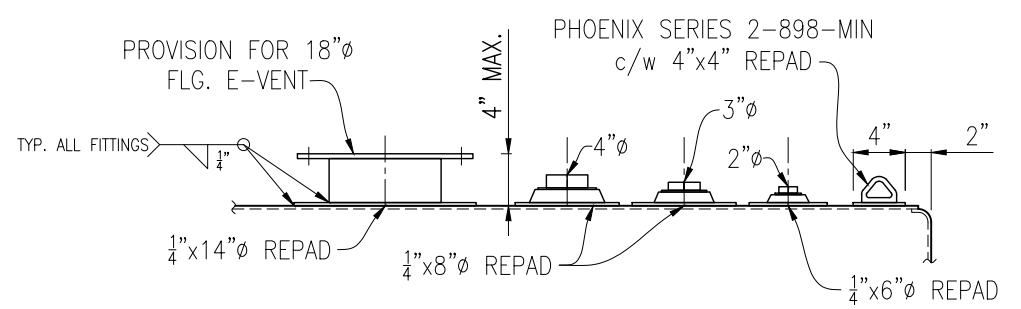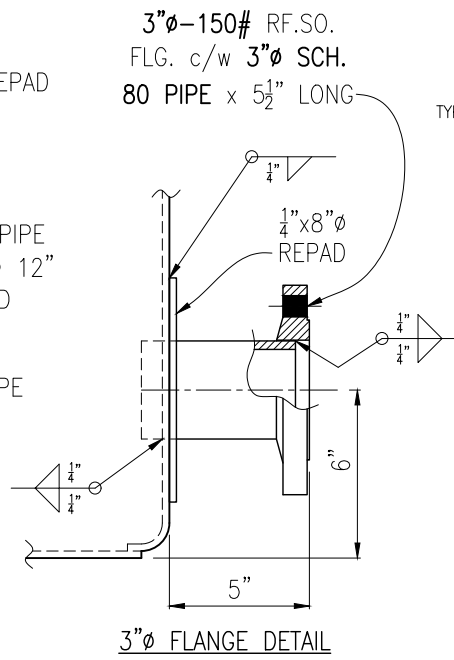
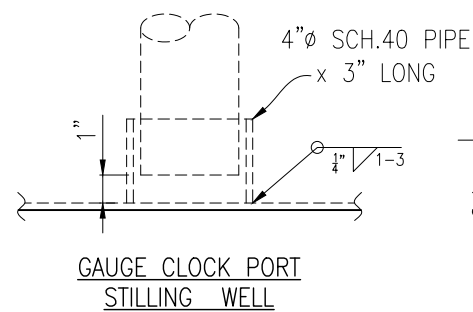
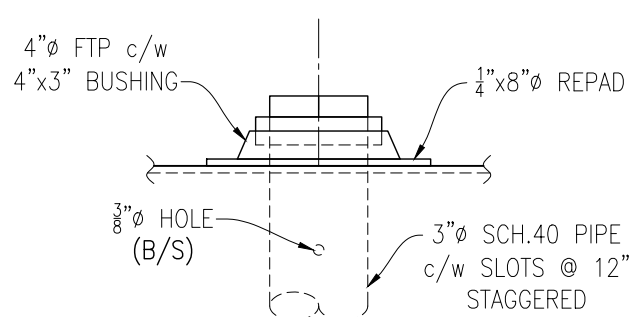
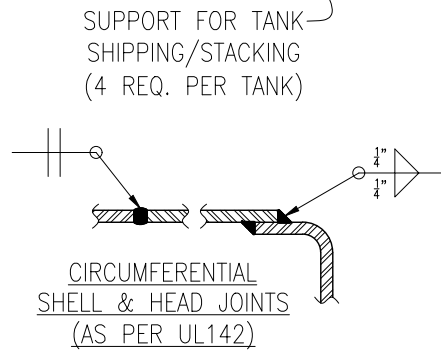
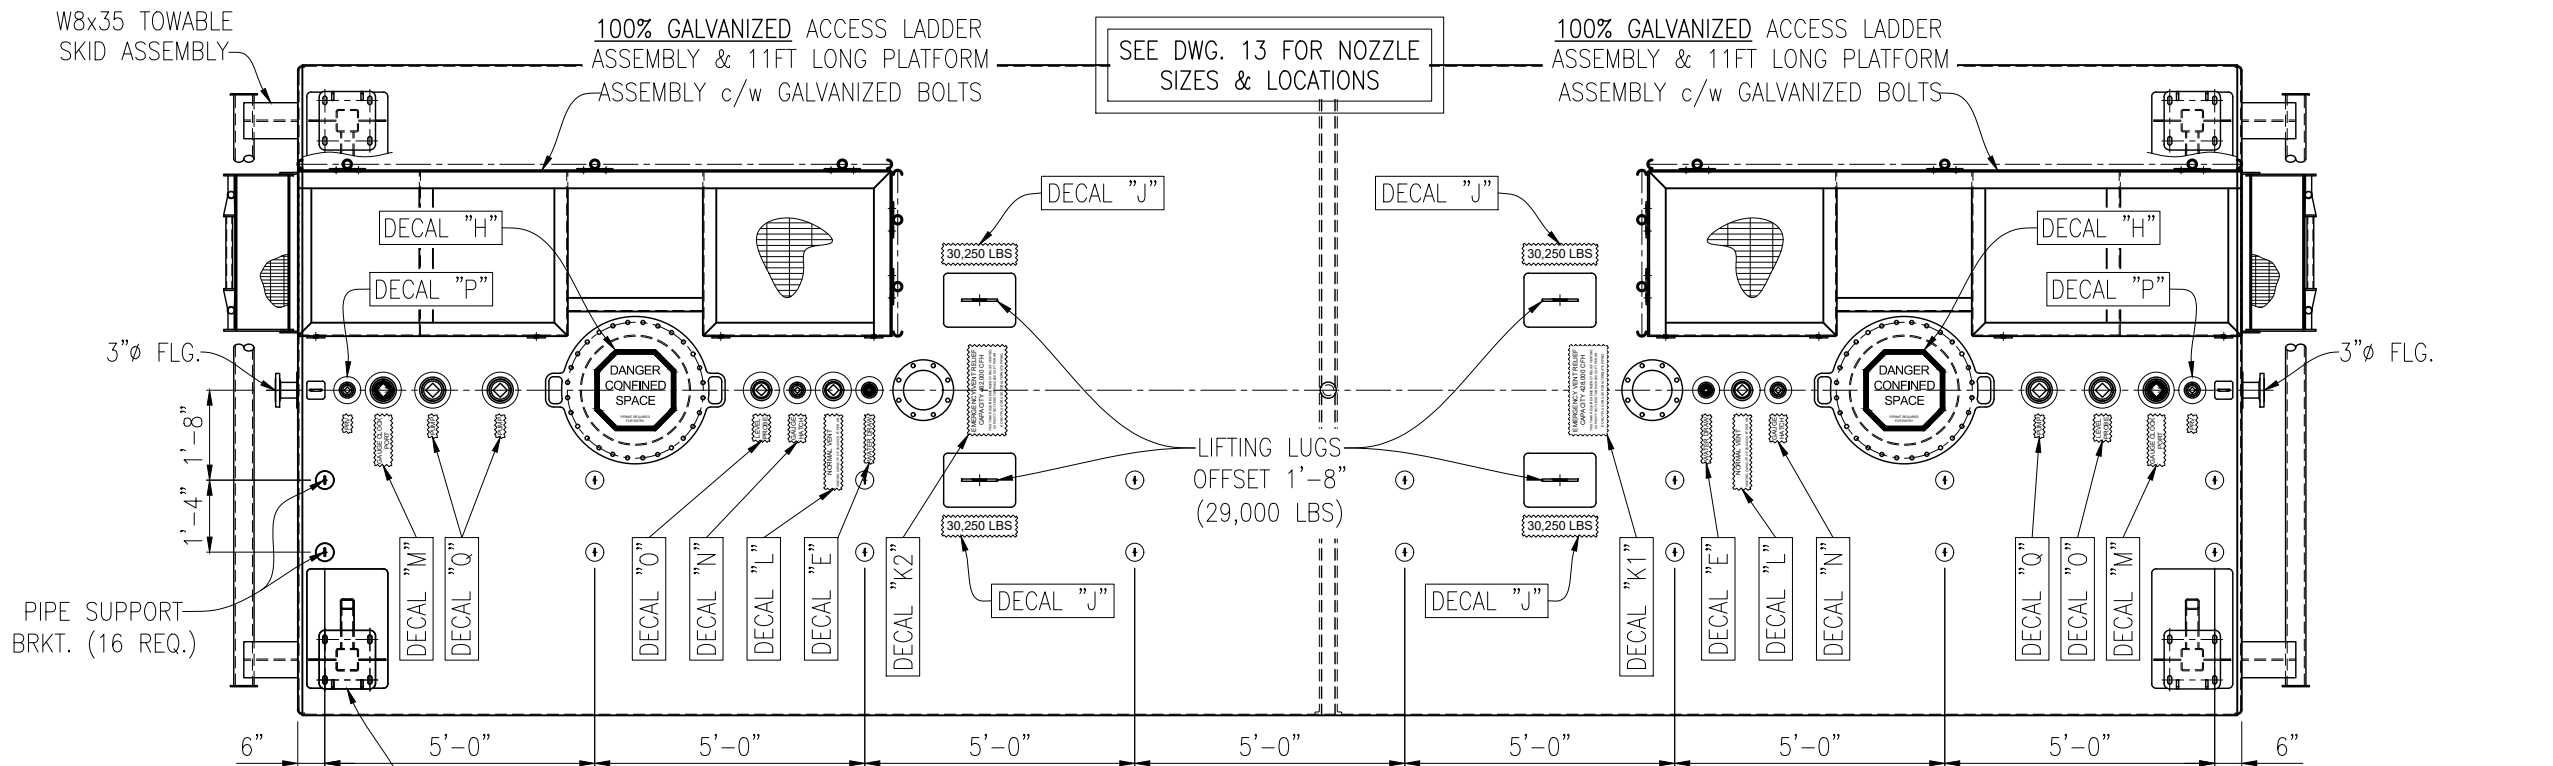


- TYPICAL PIPE SCULLY FLANGE:**
- 2"Ø FPT (G0819M-200) c/w 2"Ø PLUG (G1600M-200)
 - 3"Ø FPT (G0819M-300) c/w 2"Ø PLUG (G1600M-300)
 - 4"Ø FPT (G0819M-400) c/w 2"Ø PLUG (G1600M-400)

LONGITUDINAL SHELL JOINTS (AS PER UL142)
ALTERNATING @ 25 DEG. FROM TANK C

CUSTOMER: ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)		P.O. # 133530	TANK # (1) US1232
TITLE: TOP VIEW & FITTING DETAILS			
FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL 2-WAY SPLIT (14K/16K) SINGLE WALL TANK (UL142)			
FILE: 02\02\US1216 30000 GAL SW ALASKA VILLAGE		DRAWN: JAYDEE DEC 9, 2025	SCALE: 5/16"=1'-0"
DWG# US1216 SHEET 15 OF 17		REV B	
REGAL TANKS USA INC. PHONE (360) 707-9948 FAX (360) 707-9949			

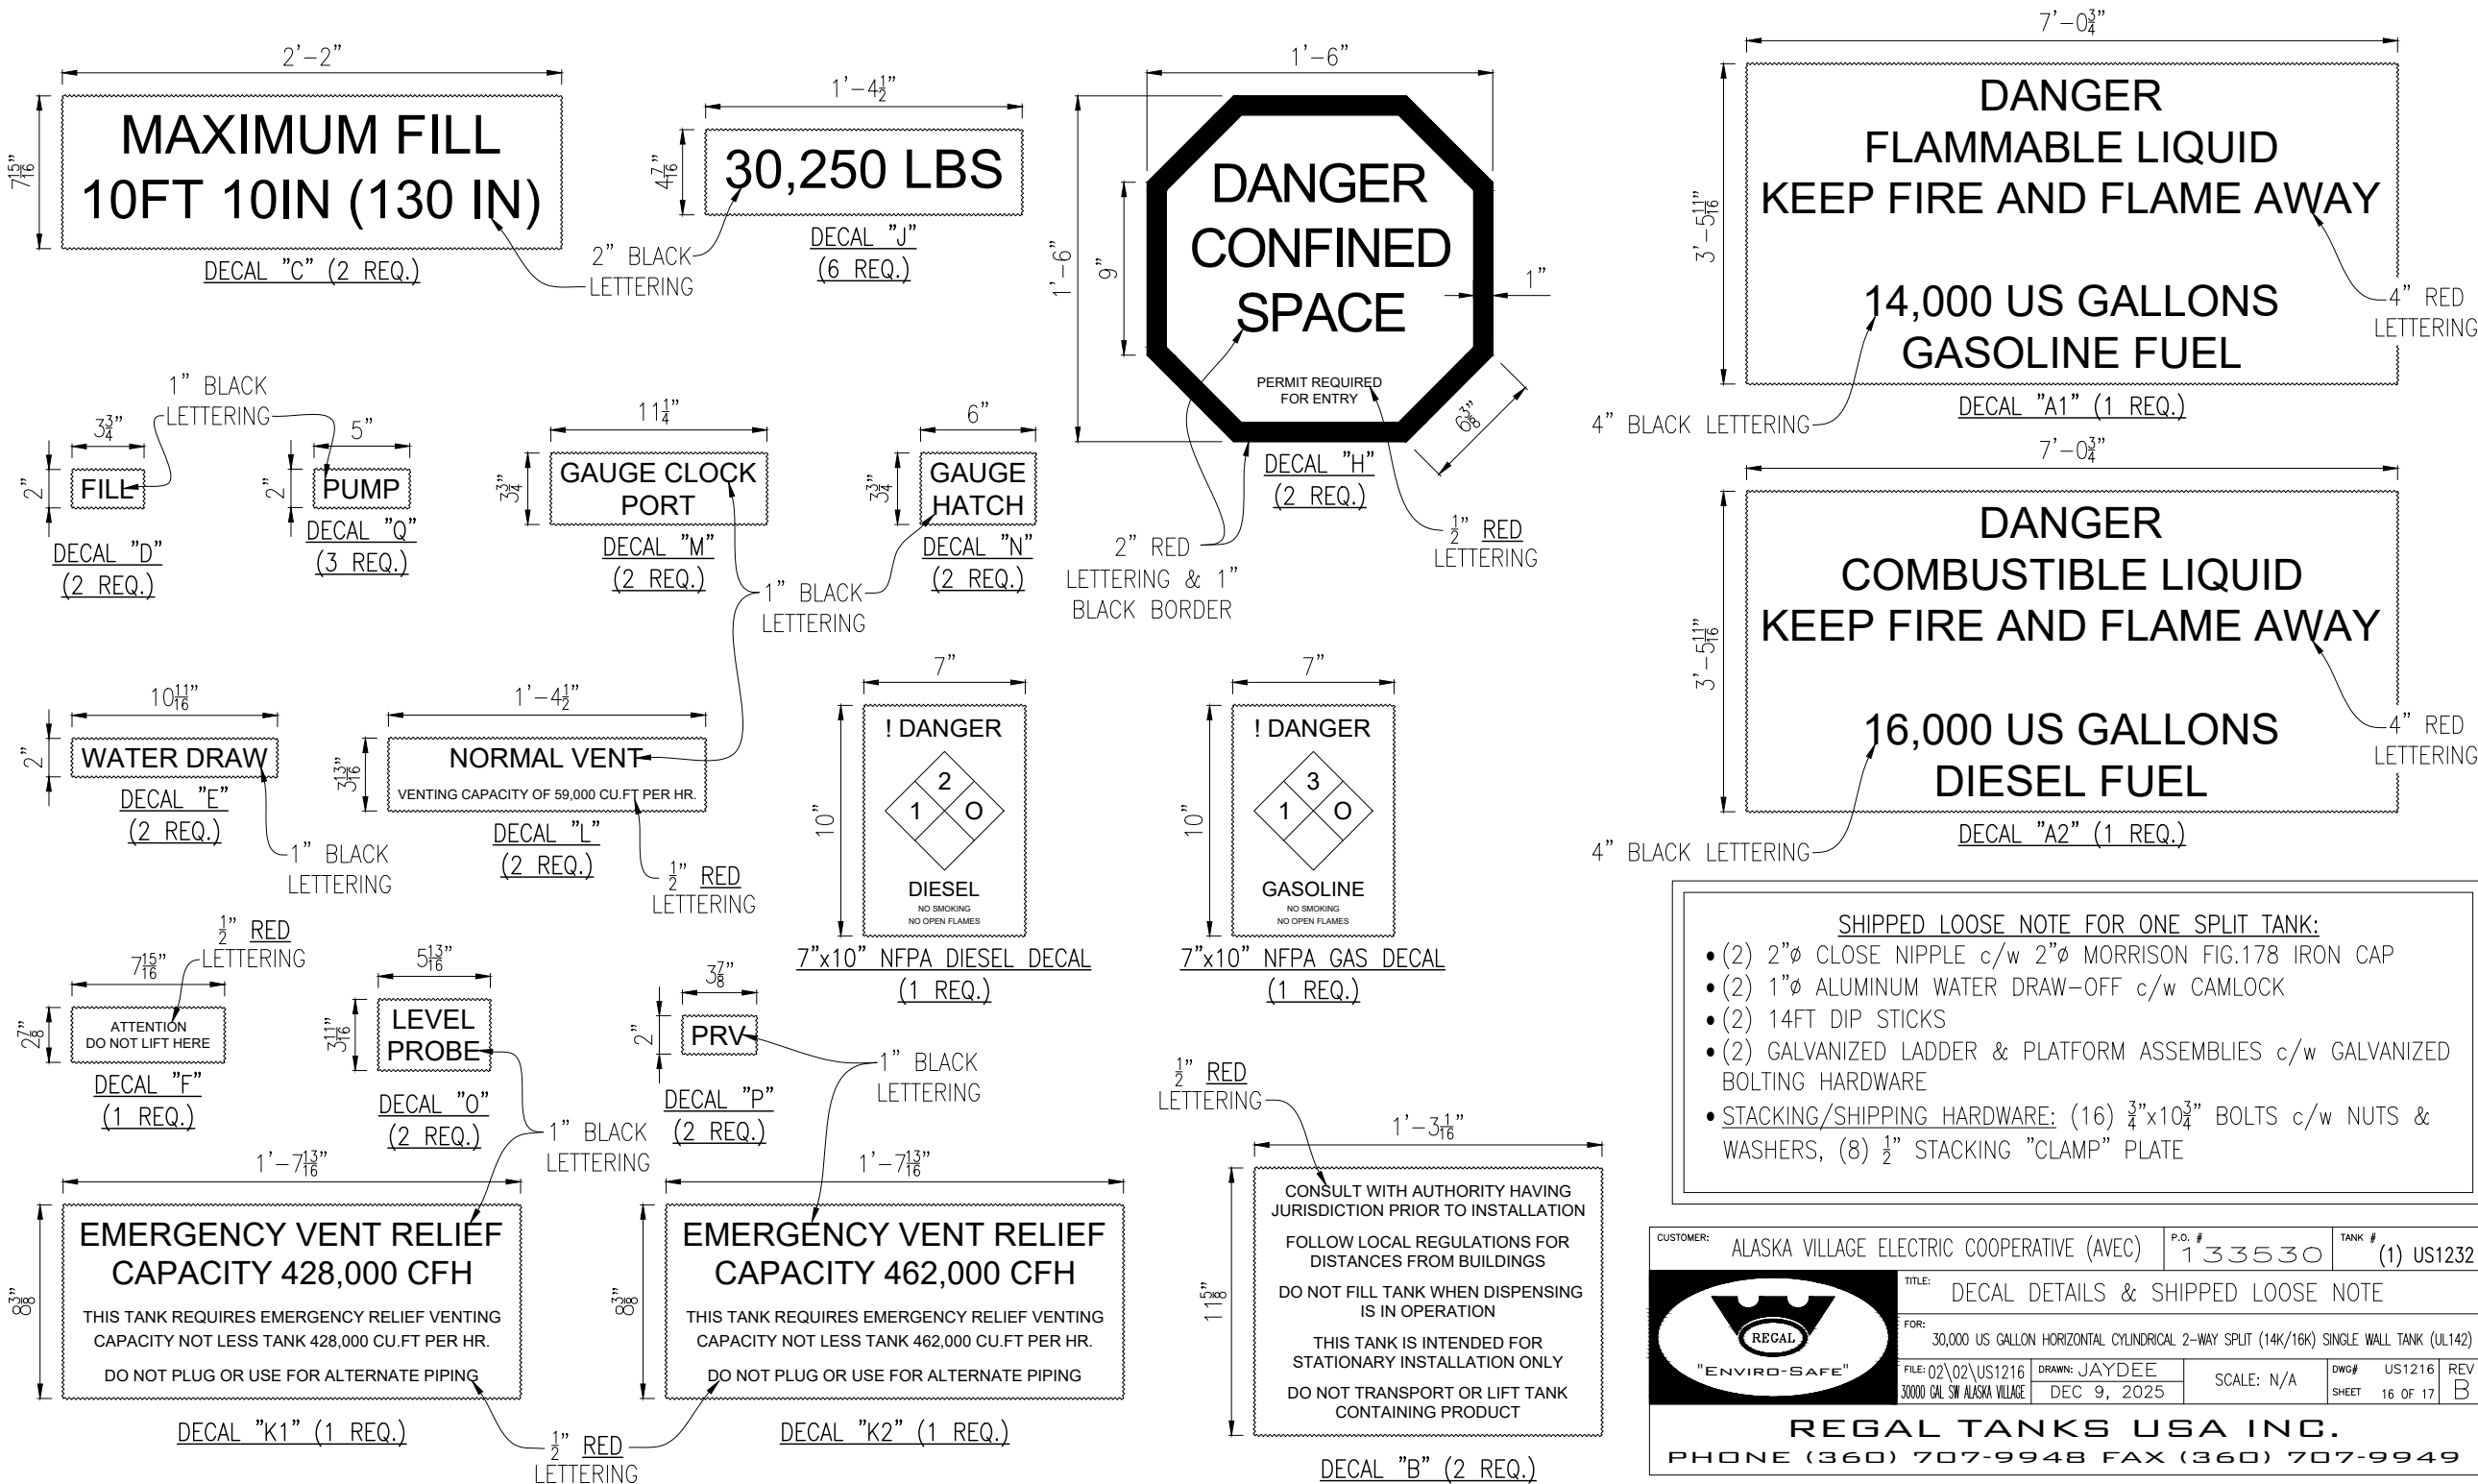

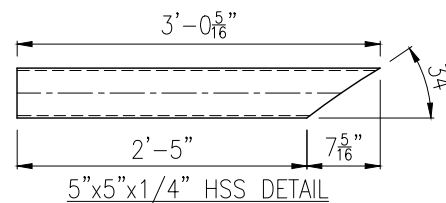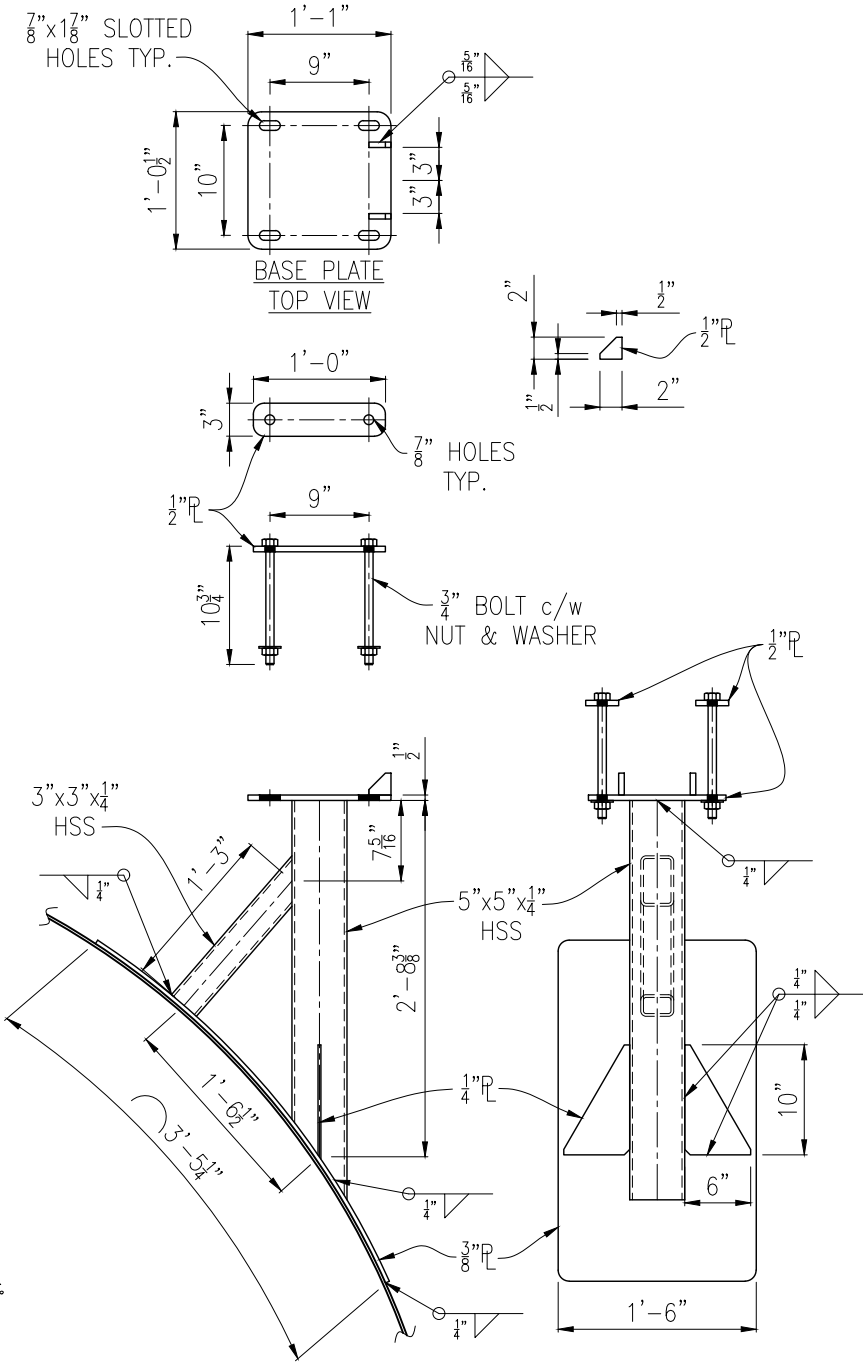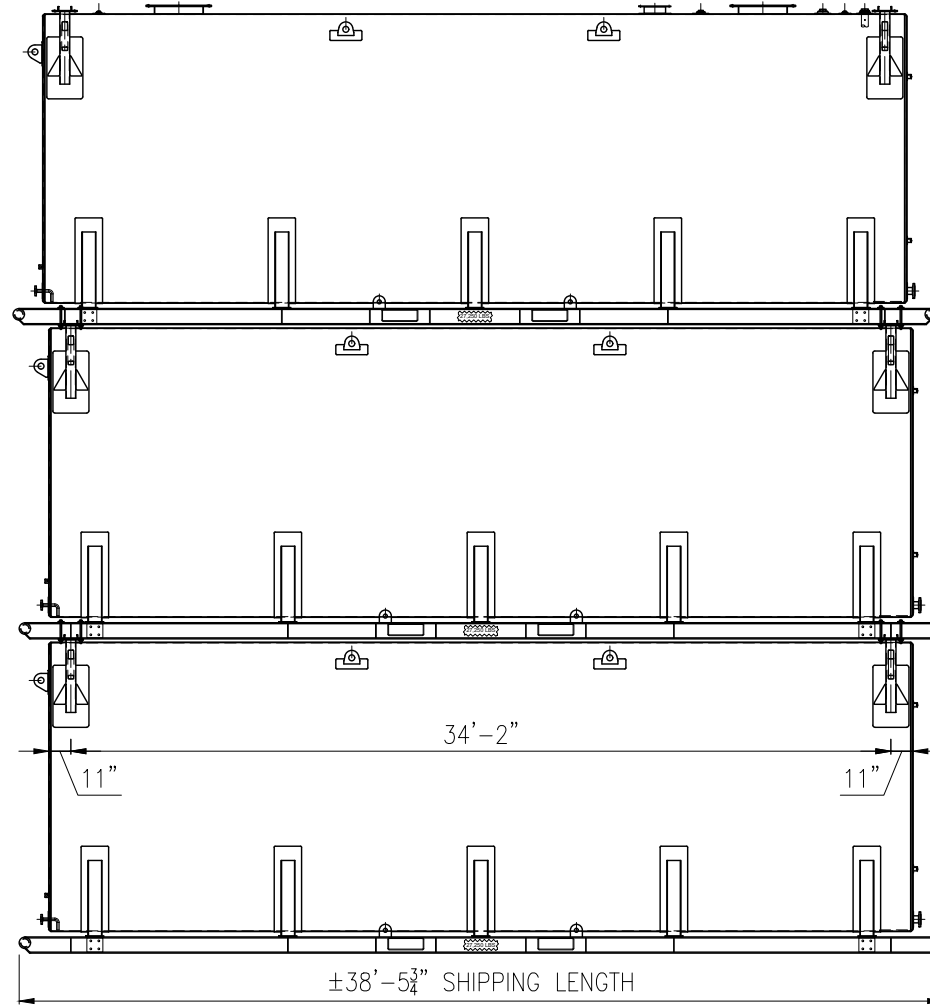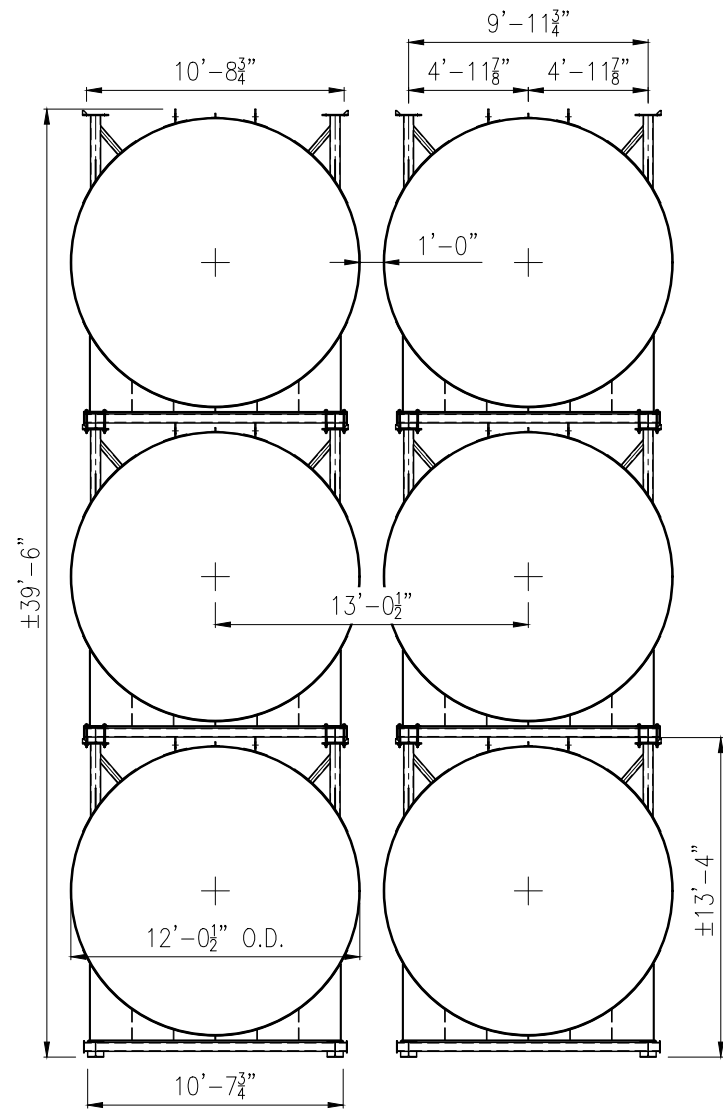

SUPPORT FOR SHIPPING STACKED TANKS
c/w HOLD DOWN BOLTS (4 SUPPORTS PER TANK)

CUSTOMER: ALASKA VILLAGE ELECTRIC COOPERATIVE (AVEC)		P.O. # 133530 & 133531		TANK # (17) US1216 TO US1232	
TITLE: STACKING DETAILS					
FOR: 30,000 US GALLON HORIZONTAL CYLINDRICAL SINGLE WALL TANK (UL142)					
FILE: 02\02\US1216 30000 GAL SW ALASKA VILLAGE		DRAWN: JAYDEE DEC 9, 2025		SCALE: N/A	
DWG# US1216 SHEET 17 OF 17		REV B			
REGAL TANKS USA INC. PHONE (360) 707-9948 FAX (360) 707-9949					

